



April 20, 2018

Ms. Carolyn Pajoum  
Evansville Department of Metropolitan Development  
Room 306 Civic Center Complex  
1 NW Martin Luther King, Jr. Blvd.  
Evansville, IN 47708-1869

RE: Asbestos Building Inspection for 2528 W. Franklin St, Evansville, Indiana – Crane Project #118-2010

Dear Ms. Pajoum:

On April 5, 2018 Ellen Mullen of Crane Environmental Services, LLC conducted an Asbestos Building Inspection to determine if there was any Asbestos Containing Material (ACM) present at the subject property. The site is a one and a half story vacant house with a finished attic, which is scheduled to be demolished.

Great care was taken to account for all spaces within the building. Hidden spaces were evaluated by physical or visual inspection as reasonably accessible. Hidden spaces include inaccessible pipe chases, sub-walls behind exposed walls, layers of tile under carpet or other tile, roofing materials under impenetrable surfaces, inaccessible sections of the building, etc. All hidden layers accessible through minor alterations were observed and tested if suspected for ACM's. Some hidden areas were assumed to contain the same materials as accessible areas that were observed.

The building inspected is vacant and may be in disrepair and in some circumstances have inaccessible areas or areas that are dangerous to enter. These areas are viewed by the inspector the best way that he/she can and may have asbestos containing material that was not sampled or noted in the report. In addition, asbestos containing roofing material may be covered by other layers of roofing, leaves, or is not viewable because of the close proximity of the adjacent buildings. The notification form attached to this report has directions as to how to handle suspect asbestos containing material that is found during demolition. If additional asbestos containing material is discovered, it should be handled according to the instructions on the attached notification form. Crane will in turn issue a revised report to the owner.

Nineteen bulk samples and one duplicate sample of suspect asbestos containing material were collected and sent to a laboratory for analysis. None of the samples were Asbestos Containing Material (ACM) defined as any material which contains more than one percent (1%) asbestos. The laboratory results are attached, and summarized as follows:

<b>Sample #</b>	<b>Material</b>	<b>Location</b>	<b>% Asbestos</b>
10-1-1	Hard Plaster Wall	Hallway	ND
10-1-2	Hard Plaster Wall	Entryway	ND
10-1-3	Hard Plaster Wall	Living Room	ND
10-1-4	Hard Plaster Ceiling	Hallway	ND
10-1-5	Hard Plaster Ceiling	Entryway	ND
10-1-6	Hard Plaster Ceiling	Living Room	ND
10-1-7	Exterior Siding	Asphalt	ND
10-1-8	Texture Wall	Entryway	ND
10-1-9	Ceiling Tile	Living Room	ND
10-1-10	Hard Plaster	Living Room	ND
10-2-1	Hard Plaster Wall	Room 1	ND
10-2-2	Hard Plaster Wall	Room 2	ND
10-2-3	Hard Plaster Wall	Room 2	ND
10-2-4	Hard Plaster Ceiling	Room 2	ND
10-2-5	Hard Plaster Ceiling	Room 2	ND
10-2-6	Hard Plaster Ceiling	Room 2	ND
10-2-7	Texture Wall	Room 1	ND
10-2-8	Texture Wall	Upstairs Bathroom	ND
10-2-9	Texture Ceiling	Room 1	ND
10-Dup-1 (10-1-1)	Hard Plaster Wall	Hallway	ND

ND – Non-detect

There is Regulated Asbestos Containing Material (RACM), Category I, and Category II ACM located in the house as indicated in the table below. Regulated ACM means (a) Friable asbestos material, (b) Category I non-friable ACM that has become friable, (c) Category I non-friable ACM that will be or has been subjected to sanding, grinding, cutting, or abrading, or (d) Category II non-friable ACM that has a high probability of becoming or has become crumbled, pulverized, or reduced to powder by the forces expected to act on the material during demolition or renovation operations. All floor tile, sheet vinyl flooring, asphalt roofing products, and flashing present was presumed to be Category I non-friable Asbestos Containing Material (ACM). The quantities of RACM and Category I and Category II ACM are summarized in the table below.

Location	Material	Column #3		Column #4		Column #5	
		RACM To Be Removed		Category I & II Non-Friable To Be Removed		Category I & II Non- Friable Not To Be Removed	
		SqFt	CuFt	SqFt	CuFt	SqFt	CuFt
Roof	Asphalt Roofing (Assumed)	0	0	0	0	1188.0	37.1
Entryway, Kitchen, Bathroom	Floor Tile & Sheet Vinyl Flooring (Assumed)	0	0	0	0	437.0	18.2
	<b>Total</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>1625.0</b>	<b>55.3</b>

All quantities are approximations. Measurements were taken where permitted and estimated where measurement was not feasible.

The RACM and Category I & II Non-Friable listed in the 3<sup>rd</sup> and 4<sup>th</sup> columns above need to be removed by an Indiana Licensed Abatement Contractor prior to demolition. The Non-Friable Category I & II ACM listed in the 5<sup>th</sup> column can remain on the substrate during demolition and disposed of in the landfill.

I have attached the laboratory results, the field inspection maps and notes, and the "Notification of Demolition and Renovation Operations" with instructions to submit to IDEM prior to demolition.

If you have any questions, please call at your convenience.

Sincerely,



Ellen Crane Mullen  
Asbestos Building Inspector #194001096  
Expiration Date 4/15/2019

Enclosures

**Indiana Department of Environmental Management  
GUIDANCE FOR PREPARING ASBESTOS  
DEMOLITION/RENOVATION NOTIFICATIONS**

**\*\*Per Indiana Rule 326 IAC 14-10-3(1), all notifications to the IDEM must be submitted on State Form Number 44593.**

**Per 326 IAC 14-10-5, demolition/renovation fees will be assessed quarterly to owners/Operators submitting notifications during the previous quarter.**

**I. Type of Notification -326 IAC 14-10-3(4).**

- A. If this is the original notice, please check the appropriate space on the notification form.
- B. If this is a revised notice, please check the appropriate space on the notification form. The revised notice must be postmarked and sent by certified mail, return receipt requested, at least 5 working days or delivered at least 2 working days before the start date of asbestos stripping or removal specified in: (1) the notice being revised **and** (2) the new revised notice. Facsimiles **will** be accepted by the IDEM.
- C. All revisions must include a copy of the notice being revised.
- D. If this is a canceled notice, please check the appropriate space on the notification form.
- E. Courtesy Notification

**II. Facility Information - 326 IAC 14-10-3(3)(B) and (R)**

- A. Either the owner or operator must submit the notice.
- B. The owner means the individual(s) who own the property or lease the property.
- C. The operator means the asbestos removal contractor or demolition contractor.
- D. Specify the name, address, telephone number, Indiana license number and license expiration date, of the:
  - 1. asbestos removal contractor,
  - 2. inspector who conducted the assessment prior to demolition or renovation and
  - 3. project designer required or asbestos projects at schools K-12, or if project designer is used for non-school projects must be licensed.

**III. Type of Operation - 326-IAC 14-10-3(3)(C), (O) and (S)**

- A. Refer to the definitions of demolition, renovation, and emergency renovation Operation in 326-IAC 14-10-2.
- B. Ordered demolitions and emergency renovation operations have additional

Notification requirements. Owner/operator must also complete Section XV or XVI of notification form.

C. Demolition by intentional burning must comply with an approved Variance from Opening Burning Regulation 326IAC 4-1.

IV. Is Asbestos Present? - Required by Federal 40 CFR Part 61, Subpart M

- A. If asbestos is present, indicate “yes” in the space provided.
- B. If asbestos is not present, indicate “no”.

V. Procedures, Including Analytical Methods, if appropriate, Used to Detect the Presence and Amount of Asbestos Material - 326 IAC 14-10-3(3)(E).

Describe how the asbestos was detected and, if samples were analyzed, specify the amount of friable asbestos visually during a walk-through inspections using a tape measure, blueprints, or pacing. Analytical methods could include the collection of samples and sample analyses by a polarized light microscope with dispersion staining.

For samples that test under 10% asbestos content: An owner or operator may (1) elect to assume material to be greater than 1% asbestos, or, (2) require verification by point counting in which the point counting result will supercede the visual estimation. Either choice and result should be stated on the notice when a sample is under 10% asbestos.

VI. Approximate Amount of Asbestos to be Removed - 326 IAC 14-10-3(3)(F)

- A. Specify the amount of regulated (friable) asbestos-containing material to be removed as follows:
  - 1. linear feet on pipes,
  - 2. square feet (surface area) on the facility components, **and**
  - 3. total cubic feet (volume) on or off all facility components. (All reported regulated amounts must be converted to cubic feet).
- B. Estimate the approximate amount of Category I and Category II non-friable asbestos-containing material in the affected part of the facility that will be removed before demolition.
- C. Estimate the approximate amount of Category I and Category II non-friable asbestos-containing material in the affected part of the facility that will not be removed before demolition.

VII. Scheduled Dates of Asbestos Stripping/Removal - 326 IAC 14-10-3(3)(H)

This means the actual start and end dates of the asbestos stripping or removal.

VIII. Scheduled Dates of Asbestos Stripping/Removal - 326 IAC 14-10-3(3)(H)

This means the starting and ending dates of the total demolition or renovation operation. For example: A renovation project may be scheduled from February 1 through March 15, 1995, however, the actual asbestos removal will occur from February 15, through 20, 1995. Demolition **must** start on date given in most recent notification.

IX. Facility Description - 326 IAC 14-10-3(3)(D) and (G)

Include the building name, floor and number of the room(s) where the asbestos stripping or removal will take place. Provide enough detail that an unfamiliar inspector can find the asbestos project without asking anyone.

X. Description of planned Demolition or Renovation Work, Methods/Techniques to be Used, and Affected Facility Components - 326 IAC 14-10-3(3)(K)

Briefly describe the methods to be used to conduct the demolition or renovation. For renovations, these methods may include gross removal, glove bag removal, hand stripping or scraping. For demolitions, methods may include a wrecking Ball, bulldozer, dynamite, or unbolting panels or sections and carefully lowering to the ground. Affected facility components may include pipe wrap, floor tile, sprayed-on insulation, transite, etc.

XI. Description of Work Practices and Engineering Controls To Be Used To Prevent Emissions of Asbestos At the Site, Including Asbestos Stripping, Removal, and Waste Handling Procedures and the Procedures to Prevent Non-Friable Asbestos Material from Becoming Friable in the Course of the Project 326 IAC 14-10-3(3)(L)

A. Examples of work practices and engineering controls to prevent asbestos emissions at the site would include: the use of water or wetting agents, containments, and negative air units during removal; placing into leak-tight containers or wrapping with six (6) mil thick polyethylene plastic sheeting which is properly labeled prior to disposal, etc.

B. Examples of removal and waste handling procedures to prevent non-friable material from becoming friable would include: removing by sections or units taking care not to crumble, pulverize, or reduce to powder, using water to prevent any emissions, placing into leak-tight containers or wrapping with six (6) mil thick plastic which is properly labeled prior to disposal (including name or waste generator and location at which the waste was generated), etc.

XII.\*\* Description of Procedures to be Followed in the Event that Unexpected Asbestos is Found or Previously Non-Friable Asbestos Material Becomes Crumbled, Pulverized or Reduced to Powder - 326 IAC 18-3 and 326 IAC 14-10-3(3)(M).

A. If the amount of unexpected asbestos or previously non-friable asbestos material is > 3 LnFt on pipes, 3 SqFt on other facility components, or a total of 0.75 CuFt on or off all facility components, then an accredited contractor (unless in-house accredited

personnel) with accredited personnel must implement the asbestos removal project in accordance with the requirements of 326 IAC 14-10.

- B. Pursuant to 326 IAC 14-10, a revised demolition/renovation notification must be submitted to the IDEM, which reflects the change in the amount of affected asbestos-containing material. The revised notice must also reflect the new asbestos removal start date, if applicable.

\*\* Required by 40 CFR Part 61, Subpart M

XIII. Waste Transporter - 326 IAC 14-10-3(3)(T)

Provide the name, address and telephone number of only the asbestos waste transporter. This should include the waste transporter's name, street address, city, state, zip code, contact person, and telephone number.

XIV. Waste Disposal site - 326 IAC 14-10-3(3)(N)

Provide the name and location of the sanitary landfill where the asbestos-containing waste material will be deposited. This should include the name, street address, city, state, zip code, waste disposal site contact person, and telephone number.

XV. If Demolition Ordered by a Governmental Agency, Identify the Agency and Attach a Copy of the Order - 326 IAC 14-10-3(3)(O)

- A. Provide the name, title and authority of the of the state or local governmental representative who has ordered the demolition .
- B. The authority is the applicable state or local regulation under which the demolition order has been issued.
- C. Attach a copy of the demolition order to the notice.

XVI. Emergency Renovations - 326 IAC 14-10-3(3)(S)

- A. Specify
  1. the date and hour that the emergency occurred,
  2. a description of the sudden unexpected event, and
  3. an explanation of how the event has caused emergency conditions
- B. An "emergency renovation operation" is a renovation operation that was not planned but results from a sudden, unexpected event. This term includes operations necessitated by non-routine failures of equipment.

XVII. Certification Statement and Signature by Owner/Operator - 326 IAC 14-10-3(3)(O) and (P)

Self-explanatory.

# INDIANA DEPARTMENT OF ENVIRONMENTAL MANAGEMENT

## NOTIFICATION OF DEMOLITION AND RENOVATION OPERATIONS

118-2010

State Form 44593 (R2 / 8-99)

<b>I. TYPE OF NOTIFICATION (check one):</b> Original _____ Revised * _____ Canceled _____ Courtesy _____ * Must include copy of notification which is being revised					
<b>II. FACILITY INFORMATION</b> (identify owner, removal contractor, demolition contractor, inspector, and project designer)					
Owner: _____					
Address: _____					
City: _____		State: _____		Zip: _____	
Contact: _____		Telephone #: _____			
Removal Contractor: _____  Address: _____  City: _____ State: _____ Zip: _____  Contact: _____ Phone: _____  IN License #: _____ Expiration: _____			Demolition Contractor: _____  Address: _____  City: _____ State: _____ Zip: _____  Contact: _____ Phone: _____		
Inspector: _____  Address: _____  City: _____ State: _____ Zip: _____  IN License #: _____ Expiration: _____  Phone: _____			(Required for asbestos projects at schools K – 12)  Project Designer: _____  Address: _____  City: _____ State: _____ Zip: _____  IN License #: _____ Expiration: _____  Phone: _____		
<b>III. TYPE OF OPERATION (check one)</b> Renovation: _____ Emergency Renovation: _____ Intentional Burning: _____ Demolition: _____ Ordered Demolition: _____					
<b>IV. IS ASBESTOS PRESENT? (check one)</b> YES: _____ NO: _____					
<b>V. PROCEDURES, INCLUDING ANALYTICAL METHODS, IF APPROPRIATE. USED TO DETECT THE PRESENCE AND AMOUNT OF ASBESTOS MATERIAL</b> _____					
<b>VI. APPROXIMATE AMOUNT OF ASBESTOS</b> (Including Regulated ACM, Category I non-friable Category II non-friable ACM)					
	Regulated ACM to be removed	Non-friable Asbestos Material To be removed		Non-friable Asbestos Material Not to be removed before demolition	
		Category I	Category II	Category I	Category II
Pipes (LnFt)					
Surface Area (SqFt)					
Total Volume (CuFt) on/off Components					
<b>VII. SCHEDULED DATES OF ASBESTOS STRIPPING/REMOVAL:</b> Start: _____ End: _____					
<b>VIII. SCHEDULED DATES OF RENOVATION:</b> Start: _____ End: _____      DEMOLITION:      Start: _____ End: _____					
<b>IX. FACILITY DESCRIPTION</b> (Including building name, floor, and room number)					
Building Name: _____					
Street Address: _____					
City: _____		State: _____		County: _____	
Location of removal within building: _____					
Building Size (SqFt): _____			# of Floors: _____		Age: _____
Present Use: _____			Prior use: _____		

X. DESCRIPTION OF PLANNED DEMOLITION OR RENOVATION WORK, METHODS/TECHNIQUES TO BE USED, AFFECTED FACILITY COMPONENTS AND TYPE OF MATERIALS REMOVED

---

---

---

---

XI. DESCRIPTION OF WORK PRACTICES AND ENGINEERING CONTROLS TO BE USED TO PREVENT EMISSIONS OF ASBESTOS AT THE SITE; INCLUDING ASBESTOS STRIPPING, REMOVAL AND WASTE HANDLING PROCEDURES TO PREVENT NON-FRIABLE ASBESTOS MATERIAL FROM BECOMING FRIABLE IN THE COURSE OF THE PROJECT:

---

---

---

XII. DESCRIPTION OF PROCEDURES TO BE FOLLOWED IN THE EVENT THAT UNEXPECTED ASBESTOS IS FOUND OR PREVIOUSLY NON-FRIABLE ASBESTOS MATERIAL BECOMES CRUMBLLED, PULVERIZED, OR REDUCED POWDER:

---

---

---

XIII. WASTE TRANSPORTER

Name: \_\_\_\_\_  
Address: \_\_\_\_\_  
City: \_\_\_\_\_ State: \_\_\_\_\_ Zip: \_\_\_\_\_  
Contact: \_\_\_\_\_ Phone: \_\_\_\_\_

XIV. WASTE DISPOSAL SITE

Name: \_\_\_\_\_  
Address: \_\_\_\_\_  
City: \_\_\_\_\_ State: \_\_\_\_\_ Zip: \_\_\_\_\_  
Contact: \_\_\_\_\_ Phone: \_\_\_\_\_

XV. IF DEMOLITION ORDERED BY A GOVERNMENT AGENCY, IDENTIFY THE AGENCY BELOW AND ATTACH A COPY OF THE ORDER TO THIS FORM. IF THE FACILITY IS NOT INSPECTED PRIOR TO DEMOLITION, THE DEBRIS MUST BE KEPT ADEQUATELY WET. THE DEBRIS MUST THEN BE INSPECTED AFTER DEMOLITION OR ASSUME ALL DEBRIS TO BE CONTAMINATED WITH RACM AND DISPOSED OF APPROPRIATELY TO COMPLY WITH 326 IAC 14-10-1(b).

Name: \_\_\_\_\_ Title: \_\_\_\_\_ Date ordered to begin: \_\_\_\_\_  
Authority: \_\_\_\_\_ Date of Order: \_\_\_\_\_

XVI. FOR EMERGENCY RENOVATIONS:

Date and time of emergency: \_\_\_\_\_

Description of sudden, unexpected event: \_\_\_\_\_

Explanation of how the event caused unsafe conditions or would cause equipment damage: \_\_\_\_\_

XVII. I HEREBY CERTIFY THAT THE INFORMATION IN THIS NOTIFICATION IS CORRECT AND THAT I WILL ONLY USE INDIANA LICENSED WORKERS AND PROJECT SUPERVISORS, TO IMPLEMENT THIS ASBESTOS PROJECT, WHICH HAVE BEEN TRAINED IN 326IAC 14-10; 40 CFR PART 61, SUBPART M; AND, IF APPLICABLE, INDIANAPOLIS AIR POLLUTION CONTROL BOARD REGULATION 14. THE TRAINED INDIVIDUAL(S) ALONG WITH EVIDENCE THAT THE REQUIRED TRAINING WAS ACCOMPLISHED SHALL BE AVAILABLE AT THE JOB SITE DURING ACTUAL WORKING HOURS.

Owner/operator (signature) \_\_\_\_\_

date \_\_\_\_\_

Owner/operator (printed) \_\_\_\_\_

affiliation \_\_\_\_\_

\*\*\*\*\* OFFICE USE ONLY \*\*\*\*\*

POSTMARK:

RECEIVED:

REVIEWED BY:

DEFICIENCIES:

Report for:


**Ellen Mullen**  
**Crane Environmental Services, LLC**  
1120 Star Gate Rd.  
Evansville, IN 47725-8232

---

Regarding: Project: 118-2010; 2528 W. Franklin St.  
EML ID: 1908107

Approved by:

Dates of Analysis:  
Asbestos PLM: 04-12-2018



Approved Signatory  
Renee Luna-Trepczynski

Service SOPs: Asbestos PLM (EPA 40CFR App E to Sub E of Part 763 & EPA METHOD 600/R-93-116, SOP EM-AS-S-1267)

---

All samples were received in acceptable condition unless noted in the Report Comments portion in the body of the report. The results relate only to the items tested. The results include an inherent uncertainty of measurement associated with estimating percentages by polarized light microscopy. Measurement uncertainty data for sample results with >1% asbestos concentration can be provided when requested.

EMLab P&K ("the Company") shall have no liability to the client or the client's customer with respect to decisions or recommendations made, actions taken or courses of conduct implemented by either the client or the client's customer as a result of or based upon the Test Results. In no event shall the Company be liable to the client with respect to the Test Results except for the Company's own willful misconduct or gross negligence nor shall the Company be liable for incidental or consequential damages or lost profits or revenues to the fullest extent such liability may be disclaimed by law, even if the Company has been advised of the possibility of such damages, lost profits or lost revenues. In no event shall the Company's liability with respect to the Test Results exceed the amount paid to the Company by the client therefor.

Client: Crane Environmental Services, LLC  
 C/O: Ellen Mullen  
 Re: 118-2010; 2528 W. Franklin St.

Date of Sampling: 04-05-2018  
 Date of Receipt: 04-09-2018  
 Date of Report: 04-12-2018

**ASBESTOS PLM REPORT****Total Samples Submitted:** 20**Total Samples Analyzed:** 20**Total Samples with Layer Asbestos Content > 1%:** 0**Location: 10-1-1, Hard plaster wall**

Lab ID-Version‡: 8965921-1

Sample Layers	Asbestos Content
Brown Fibrous Material	ND
Gray Skim Coat with Brown Surface	ND
Gray Base Coat	ND
<b>Composite Non-Asbestos Content:</b>	2% Cellulose < 1% Hair/Wool
<b>Sample Composite Homogeneity:</b>	Poor

**Location: 10-1-2, Hard plaster wall**

Lab ID-Version‡: 8965922-1

Sample Layers	Asbestos Content
Brown Fibrous Material	ND
Gray Skim Coat with Brown Surface	ND
Gray Base Coat	ND
<b>Composite Non-Asbestos Content:</b>	2% Cellulose < 1% Hair/Wool
<b>Sample Composite Homogeneity:</b>	Poor

**Location: 10-1-3, Hard plaster wall**

Lab ID-Version‡: 8965923-1

Sample Layers	Asbestos Content
White Drywall with Brown Paper	ND
<b>Composite Non-Asbestos Content:</b>	5% Cellulose
<b>Sample Composite Homogeneity:</b>	Moderate

The test report shall not be reproduced except in full, without written approval of the laboratory. The report must not be used by the client to claim product certification, approval, or endorsement by any agency of the federal government. EMLab P&K reserves the right to dispose of all samples after a period of thirty (30) days, according to all state and federal guidelines, unless otherwise specified.

Inhomogeneous samples are separated into homogeneous subsamples and analyzed individually. ND means no fibers were detected. When detected, the minimum detection and reporting limit is less than 1% unless point counting is performed. Floor tile samples may contain large amounts of interference material and it is recommended that the sample be analyzed by gravimetric point count analysis to lower the detection limit and to aid in asbestos identification.

‡ A "Version" indicated by "-x" after the Lab ID# with a value greater than 1 indicates a sample with amended data. The revision number is reflected by the value of "x".

Client: Crane Environmental Services, LLC  
C/O: Ellen Mullen  
Re: 118-2010; 2528 W. Franklin St.

Date of Sampling: 04-05-2018  
Date of Receipt: 04-09-2018  
Date of Report: 04-12-2018

**ASBESTOS PLM REPORT****Location: 10-1-4, Hard plaster ceiling**

Lab ID-Version‡: 8965924-1

Sample Layers	Asbestos Content
Brown Fibrous Material	ND
Gray Skim Coat with Brown Surface	ND
Gray Base Coat	ND
<b>Composite Non-Asbestos Content:</b>	2% Cellulose < 1% Hair/Wool
<b>Sample Composite Homogeneity:</b>	Poor

The test report shall not be reproduced except in full, without written approval of the laboratory. The report must not be used by the client to claim product certification, approval, or endorsement by any agency of the federal government. EMLab P&K reserves the right to dispose of all samples after a period of thirty (30) days, according to all state and federal guidelines, unless otherwise specified.

Inhomogeneous samples are separated into homogeneous subsamples and analyzed individually. ND means no fibers were detected. When detected, the minimum detection and reporting limit is less than 1% unless point counting is performed. Floor tile samples may contain large amounts of interference material and it is recommended that the sample be analyzed by gravimetric point count analysis to lower the detection limit and to aid in asbestos identification.

‡ A "Version" indicated by "-x" after the Lab ID# with a value greater than 1 indicates a sample with amended data. The revision number is reflected by the value of "x".

Client: Crane Environmental Services, LLC  
 C/O: Ellen Mullen  
 Re: 118-2010; 2528 W. Franklin St.

Date of Sampling: 04-05-2018  
 Date of Receipt: 04-09-2018  
 Date of Report: 04-12-2018

**ASBESTOS PLM REPORT****Location: 10-1-5, Hard plaster ceiling**

Lab ID-Version‡: 8965925-1

Sample Layers	Asbestos Content
Brown Fibrous Material	ND
Gray Skim Coat with Brown Surface	ND
Gray Base Coat	ND
<b>Composite Non-Asbestos Content:</b>	2% Cellulose < 1% Hair/Wool
<b>Sample Composite Homogeneity:</b>	Poor

**Location: 10-1-6, Hard plaster ceiling**

Lab ID-Version‡: 8965926-1

Sample Layers	Asbestos Content
Off-White Plaster with Brown Paint	ND
<b>Composite Non-Asbestos Content:</b>	< 1% Hair/Wool
<b>Sample Composite Homogeneity:</b>	Good

**Location: 10-1-7, Asphalt siding**

Lab ID-Version‡: 8965927-1

Sample Layers	Asbestos Content
Black Asphalt with Gray Pebbles	ND
Brown Fibrous Material	ND
<b>Composite Non-Asbestos Content:</b>	10% Cellulose
<b>Sample Composite Homogeneity:</b>	Moderate

**Location: 10-1-8, Texture**

Lab ID-Version‡: 8965928-1

Sample Layers	Asbestos Content
White Texture with Beige Paint	ND
<b>Sample Composite Homogeneity:</b>	Good

The test report shall not be reproduced except in full, without written approval of the laboratory. The report must not be used by the client to claim product certification, approval, or endorsement by any agency of the federal government. EMLab P&K reserves the right to dispose of all samples after a period of thirty (30) days, according to all state and federal guidelines, unless otherwise specified.

Inhomogeneous samples are separated into homogeneous subsamples and analyzed individually. ND means no fibers were detected. When detected, the minimum detection and reporting limit is less than 1% unless point counting is performed. Floor tile samples may contain large amounts of interference material and it is recommended that the sample be analyzed by gravimetric point count analysis to lower the detection limit and to aid in asbestos identification.

‡ A "Version" indicated by "-x" after the Lab ID# with a value greater than 1 indicates a sample with amended data. The revision number is reflected by the value of "x".

Client: Crane Environmental Services, LLC  
 C/O: Ellen Mullen  
 Re: 118-2010; 2528 W. Franklin St.

Date of Sampling: 04-05-2018  
 Date of Receipt: 04-09-2018  
 Date of Report: 04-12-2018

**ASBESTOS PLM REPORT****Location: 10-1-9, Ceiling tile**

Lab ID-Version‡: 8965929-1

Sample Layers	Asbestos Content
Gray Ceiling Tile with White Surface	ND
<b>Composite Non-Asbestos Content:</b>	50% Cellulose 10% Glass Fibers
<b>Sample Composite Homogeneity:</b>	Good

**Location: 10-1-10, Hard plaster (chimney)**

Lab ID-Version‡: 8965930-1

Sample Layers	Asbestos Content
White Compound with Multilayered Paint	ND
Off-White Plaster	ND
<b>Composite Non-Asbestos Content:</b>	< 1% Cellulose < 1% Hair/Wool
<b>Sample Composite Homogeneity:</b>	Moderate

**Location: 10-2-1, Hard plaster wall**

Lab ID-Version‡: 8965931-1

Sample Layers	Asbestos Content
White Compound with Multilayered Paint	ND
White Plaster	ND
<b>Composite Non-Asbestos Content:</b>	< 1% Cellulose
<b>Sample Composite Homogeneity:</b>	Moderate

**Location: 10-2-2, Hard plaster wall**

Lab ID-Version‡: 8965932-1

Sample Layers	Asbestos Content
White Skim Coat with Blue Paint	ND
Light Brown Base Coat	ND
<b>Composite Non-Asbestos Content:</b>	< 1% Hair/Wool
<b>Sample Composite Homogeneity:</b>	Moderate

The test report shall not be reproduced except in full, without written approval of the laboratory. The report must not be used by the client to claim product certification, approval, or endorsement by any agency of the federal government. EMLab P&K reserves the right to dispose of all samples after a period of thirty (30) days, according to all state and federal guidelines, unless otherwise specified.

Inhomogeneous samples are separated into homogeneous subsamples and analyzed individually. ND means no fibers were detected. When detected, the minimum detection and reporting limit is less than 1% unless point counting is performed. Floor tile samples may contain large amounts of interference material and it is recommended that the sample be analyzed by gravimetric point count analysis to lower the detection limit and to aid in asbestos identification.

‡ A "Version" indicated by -"x" after the Lab ID# with a value greater than 1 indicates a sample with amended data. The revision number is reflected by the value of "x".

Client: Crane Environmental Services, LLC  
 C/O: Ellen Mullen  
 Re: 118-2010; 2528 W. Franklin St.

Date of Sampling: 04-05-2018  
 Date of Receipt: 04-09-2018  
 Date of Report: 04-12-2018

**ASBESTOS PLM REPORT****Location: 10-2-3, Hard plaster wall**

Lab ID-Version‡: 8965933-1

Sample Layers	Asbestos Content
Brown Fibrous Material	ND
White Compound with Green Paint	ND
Gray Plaster	ND
<b>Composite Non-Asbestos Content:</b>	2% Cellulose < 1% Hair/Wool
<b>Sample Composite Homogeneity:</b>	Poor

**Location: 10-2-4, Hard plaster ceiling**

Lab ID-Version‡: 8965934-1

Sample Layers	Asbestos Content
White Skim Coat with Multilayered Paint	ND
Light Gray Base Coat	ND
<b>Composite Non-Asbestos Content:</b>	< 1% Hair/Wool
<b>Sample Composite Homogeneity:</b>	Moderate

**Location: 10-2-5, Hard plaster ceiling**

Lab ID-Version‡: 8965935-1

Sample Layers	Asbestos Content
White Compound with White Paint	ND
White Skim Coat with Gray Paint	ND
Light Brown Base Coat	ND
<b>Composite Non-Asbestos Content:</b>	< 1% Hair/Wool
<b>Sample Composite Homogeneity:</b>	Poor

**Location: 10-2-6, Hard plaster ceiling**

Lab ID-Version‡: 8965936-1

Sample Layers	Asbestos Content
White Skim Coat with Gray Paint	ND
Light Brown Base Coat	ND
<b>Composite Non-Asbestos Content:</b>	< 1% Hair/Wool
<b>Sample Composite Homogeneity:</b>	Moderate

The test report shall not be reproduced except in full, without written approval of the laboratory. The report must not be used by the client to claim product certification, approval, or endorsement by any agency of the federal government. EMLab P&K reserves the right to dispose of all samples after a period of thirty (30) days, according to all state and federal guidelines, unless otherwise specified.

Inhomogeneous samples are separated into homogeneous subsamples and analyzed individually. ND means no fibers were detected. When detected, the minimum detection and reporting limit is less than 1% unless point counting is performed. Floor tile samples may contain large amounts of interference material and it is recommended that the sample be analyzed by gravimetric point count analysis to lower the detection limit and to aid in asbestos identification.

‡ A "Version" indicated by "-x" after the Lab ID# with a value greater than 1 indicates a sample with amended data. The revision number is reflected by the value of "x".

Client: Crane Environmental Services, LLC  
 C/O: Ellen Mullen  
 Re: 118-2010; 2528 W. Franklin St.

Date of Sampling: 04-05-2018  
 Date of Receipt: 04-09-2018  
 Date of Report: 04-12-2018

**ASBESTOS PLM REPORT****Location: 10-2-7, Texture**

Lab ID-Version‡: 8965937-1

Sample Layers	Asbestos Content
White Texture with Multilayered Paint	ND
<b>Sample Composite Homogeneity:</b>	Good

**Location: 10-2-8, Texture**

Lab ID-Version‡: 8965938-1

Sample Layers	Asbestos Content
White Texture with Multilayered Paint	ND
<b>Sample Composite Homogeneity:</b>	Good

**Location: 10-2-9, Texture**

Lab ID-Version‡: 8965939-1

Sample Layers	Asbestos Content
White Texture with Multilayered Paint	ND
<b>Sample Composite Homogeneity:</b>	Good

**Location: 10-Dup-1, Hard plaster wall**

Lab ID-Version‡: 8965940-1

Sample Layers	Asbestos Content
Brown Fibrous Material	ND
Gray Skim Coat	ND
Gray Base Coat	ND
<b>Composite Non-Asbestos Content:</b>	2% Cellulose < 1% Hair/Wool
<b>Sample Composite Homogeneity:</b>	Poor

The test report shall not be reproduced except in full, without written approval of the laboratory. The report must not be used by the client to claim product certification, approval, or endorsement by any agency of the federal government. EMLab P&K reserves the right to dispose of all samples after a period of thirty (30) days, according to all state and federal guidelines, unless otherwise specified.

Inhomogeneous samples are separated into homogeneous subsamples and analyzed individually. ND means no fibers were detected. When detected, the minimum detection and reporting limit is less than 1% unless point counting is performed. Floor tile samples may contain large amounts of interference material and it is recommended that the sample be analyzed by gravimetric point count analysis to lower the detection limit and to aid in asbestos identification.

‡ A "Version" indicated by -"x" after the Lab ID# with a value greater than 1 indicates a sample with amended data. The revision number is reflected by the value of "x".

## CHAIN OF CUSTODY

www.EMLabPK.com



Cherry Hill, NJ: 1936 Olney Avenue, Cherry Hill, NJ 08003 • (866) 871-1994  
 Phoenix, AZ: 1501 West Knudsen Drive, Phoenix, AZ 85027 • (800) 651-4802  
 San Bruno, CA: 1150 Bayhill Drive, #100, San Bruno, CA 94066 • (866) 888-6653

WEATHER		For
LEVEL	Non	
	Ugl	
	Max	
	Mean	

001908107

CONTACT INFORMATION						REQUESTED SERVICES (✓ Boxes)	
Company: Crane Environmental Services, LLC			Address: 1120 Star Gate Court, Evansville, IN 47725			Culturable	
Contact: Ellen R. Mullen			Special Instructions:			BioCassette™ Andersen, SAS, Swab, Water, Bulk, Dust, Soil, Contact Plate	
Phone: (812) 868-0709			Account #: 4001			Other Requests	
PROJECT INFORMATION			TURN AROUND TIME CODES - (TAT)			Fungi - Spore Trap Analysis	
Project ID: 118-2010			STD - Standard (DEFAULT)			Spore Trap Analysis - Other particles	
Project Desc.: 2528 W. Franklin St.			ND - Next Business Day			Direct Microscopic Exam (Qualitative)	
Project: 47712			SD - Same Business Day Rush			Quantitative Spore Count Direct Exam	
Zip Code: 47712			WH - Weekend/Holiday			1-Media Surface Fungi (Genus ID + Age spp.)	
PO Number:			Rushes received after 2pm or on weekends, will be considered received the next business day. Please alert us in advance of weekend analysis needs.			2-Media Surface Fungi (Genus ID + Age spp.)	
Sampling Date & Time: 4/5/18 12:10 p.m.						3-Media Surface Fungi (Genus ID + Age spp.)	
SAMPLE ID	DESCRIPTION	Sample Type (Below)	TAT (Above)	Total Volume/Area (as applicable)	NOTES (Time of day, Temp, RH, etc.)	Culturable Air Fungi (Genus ID + Age spp.)	Gram Stain and Counts (Culturable Air and Surface Bacteria)
10-1-1	Hard Plaster Wall	B	STD			Legionella culture	Total Coliform, E. coli (Presence/Absence)
10-1-2	Hard Plaster Wall	B	STD			Membrane Filtration (Please specify organism)	MPN Bacteria (Please specify organism)
10-1-3	Hard Plaster Wall	B	STD			Quantitative - Sewage Screen	Adenosine Analysis - PCM Airborne Filter Count (NIOSH 7400)
10-1-4	Hard Plaster Ceiling	B	STD				Adenosine Analysis - Bulk (EPA method 8060/11-93-116)
10-1-5	Hard Plaster Ceiling	B	STD				PCR (please specify test)
10-1-6	Hard Plaster Ceiling	B	STD				
10-1-7	Asphalt Siding	B	STD				
10-1-8	Texture	B	STD				
10-1-9	Ceiling Tile	B	STD				
10-1-10	Hard Plaster (Chimney)	B	STD				
10-2-1	Hard Plaster Wall	B	STD				
10-2-2	Hard Plaster Wall	B	STD				
SAMPLE TYPE CODES				RELINQUISHED BY		DATE & TIME	
BC - BioCassette™	CP - Contact Plate	T - Tape	D - Dust	David B...		4/6/18 12:00 P.M.	
AIS - Andersen	ST - Spore Trap; Zefon, Allergenco, Burkard...	SW - Swab	W - Water	Fedex 930		4/9/18	
SAS - Surface Air Sampler		B - Bulk	SO - Soil			K. (in PPA)	
O - Other:							

By submitting this Chain of Custody, you agree to be bound by the terms and conditions set forth at [www.emlabpk.com/terms.html](http://www.emlabpk.com/terms.html)

Copyright © 2002-2008 EMLab P&amp;K

**www.EMLabPK.com**



## EMLab P&K



001908107

Cherry Hill, NJ: 1936 Olney Avenue, Cherry Hill, NJ 08003 • (856) 371-1984  
Phoenix, AZ: 1501 West Knudsen Drive, Phoenix, AZ 85027 • (800) 651-4802  
San Bruno, CA: 1150 Saybill Drive, #100, San Bruno, CA 94066 • (866) 888-6653

## CONTACT INFORMATION

Company: Crane Environmental Services, LLC

Address: 1120 Star Gate Court, Evansville, IN 47725

Contact: Ellen R. Mullen

Special Instructions:

Phone: (812) 868-0709

Account #: 4001

## PROJECT INFORMATION

### TURN AROUND TIME CODES (TAT)

Project ID: 118-2010

**STD** - Standard (DEFAULT)

Project Desc.: 2528 W. Franklin St.

**ND** - Next Business Day

Project	47712	Sampling	4/5/18 12:10 p.m.
Zip Code		Date & Time	

SD - Same Business Day Rush

PO Number:

WH - Weekend/Holiday

**Rushes received after 2pm or on weekends, will be considered received the next business day. Please alert us in advance of weekend analysis needs.**

SAMPLE ID	DESCRIPTION	Sample Type (Below)	TAT (Above)	Total Volume/Area (as applicable)	NOTES (Time of day, Temp, RH, etc.)
10-2-3	Hard Plaster Wall	B	STD		
10-2-4	Hard Plaster Ceiling	B	STD		
10-2-5	Hard Plaster Ceiling	B	STD		
10-2-6	Hard Plaster Ceiling	B	STD		
10-2-7	Texture	B	STD		
10-2-8	Texture	B	STD		
10-2-9	Texture	B	STD		
10-Dup-1	Hard Plaster Wall	B	STD		

SAMPLE TYPE CODES				RELINQUISHED BY	DATE & TIME
BC - BioCassette™	CP - Contact Plate	T - Tape	D - Dust	<i>Jared Bann</i>	4/8/18 12:00
A15 - Andersen	ST - Spore Trap: Zefon, Allergenco, Burkard...	SW - Swab	W - Water	<i>Fedex 470</i>	<i>4/9/18</i>
SAS - Surface Air Sampler		B - Bulk	SO - Soil		
O - Other:					

**REQUESTED SERVICES (✓ Boxes)**

[illegible]

By submitting this Chain of Custody, you agree to be bound by the terms and conditions set forth at [www.emlabpk.com/terms.html](http://www.emlabpk.com/terms.html)

Copyright © 2002-2008 EMLab P&K

# CES

Crane Environmental Services, Inc.

1120 Star Gate Court

Evansville, IN 47725

(812) 868-0709 Fax: (812) 868-1232

Evansville, IN 47724-7021

# CHAIN OF CUSTODY

Project: 118-2010

Sampled By: Ellen Mullen

Location: 2528 W. Franklin St

Date: 4/ /2018

DATE	SAMPLE #	MATERIAL SAMPLED	LOCATION	Notes
	1-1	HP	H	Dup-1
	1-2	HP	E	
	1-3	HP	LV	
	1-4	HP	H	
	1-5	HP	E	
	1-6	HP	LV	
	1-7	asphalt	exterior	
	1-8	text	E	
		SVF	E K Both	12'x10 , 15'x16 , 11x7
	1-9	CT	LV	
	1-10	HP	LV	chimney
	2-7	text	R1	
	2-8	text	both upstairs	
	2-9	text	R1	
	2-1	HP	R1	
	2-2	HP	R2	
	2-3	HP	R2	
	2-4	HP	R2	

KEY	PI	Pipe Insulation	JC	Joint Comp.	FT	Floor Tile	CLK	Caulking
	PJ	Pipe Joint	INS	Insulation	ShVF	Sheet Vinyl	OT	Other (explain)
	HP	Hard Plaster	CT	Ceiling Tile	TR	Transite	UK	Unknown

**Crane Environmental Services, Inc.**  
1120 Star Gate Court  
Evansville, IN 47725  
(812) 868-0709 Fax: (812) 868-1232  
Evansville, IN 47724-7021

**Location:** 2528 W. Franklin St  
**Date:** 4/ /2018

<b>KEY</b>	<b>PI</b>	Pipe Insulation	<b>JC</b>	Joint Comp.	<b>FT</b>	Floor Tile	<b>CLK</b>	Caulking
	<b>PJ</b>	Pipe Joint	<b>INS</b>	Insulation	<b>ShVF</b>	Sheet Vinyl	<b>OT</b>	Other (explain)
	<b>HP</b>	Hard Plaster	<b>CT</b>	Ceiling Tile	<b>TR</b>	Transite	<b>UK</b>	Unknown

# CES

Crane Environmental Services, Inc.

1120 Star Gate Court

Evansville, IN 47725

(812) 868-0709 Fax: (812) 868-1232

Evansville, IN 47724-7021

# SAMPLING DIAGRAM

Project: 118-2010

Sampled By: Ellen Mullen

Location: 2528 W. Franklin St

Date: 4/5/2018

12:10pm - 12:45pm

First Floor

Roofing: Shingles Rolled Other metal


Siding: Transite Wood Other asphalt

Garage: Yes No Shed

G. Roof: Shingles Rolled Other \_\_\_\_\_

Basement: Yes No

2nd Floor: Finished Unfinished No

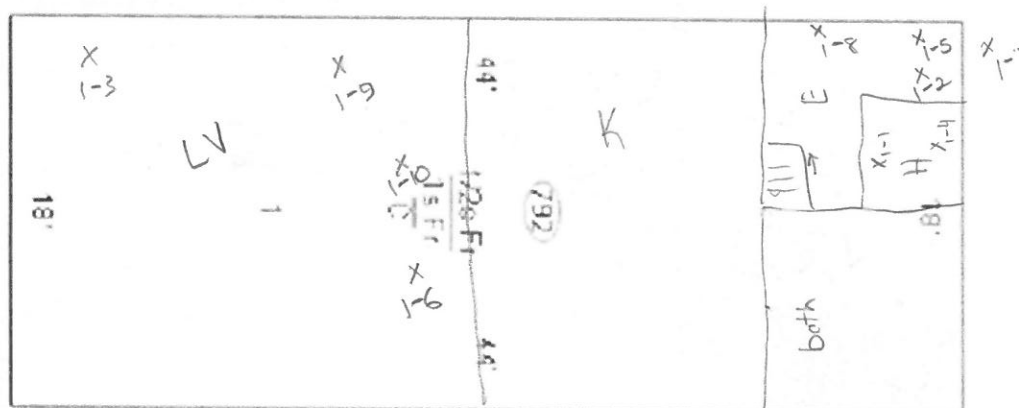

KEY	PI	Pipe Insulation	JC	Joint Comp.	FT	Floor Tile	CLK	Caulking
	PJ	Pipe Joint	INS	Insulation	ShVF	Sheet Vinyl	OT	Other
	HP	Hard Plaster	CT	Ceiling Tile	TR	Transite	UK	Unknown

# CES

Crane Environmental Services, Inc.

1120 Star Gate Court

Evansville, IN 47725

(812) 868-0709 Fax: (812) 868-1232

Evansville, IN 47724-7021

# SAMPLING DIAGRAM

Project: 118-2010

Sampled By: Ellen Mullen

Location: 2528 W. Franklin St

Date: 4/ /2018

Second Floor

Roofing: Shingles Rolled Other \_\_\_\_\_


Siding: Transite Wood Other \_\_\_\_\_

Garage: Yes No Shed

G. Roof: Shingles Rolled Other \_\_\_\_\_

Basement: Yes No

2nd Floor: Finished Unfinished No

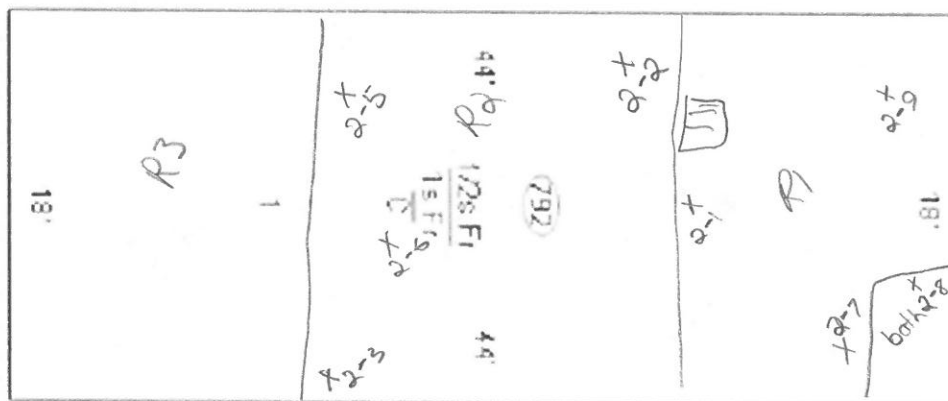

KEY	PI	Pipe Insulation	JC	Joint Comp.	FT	Floor Tile	CLK	Caulking
	PJ	Pipe Joint	INS	Insulation	ShVF	Sheet Vinyl	OT	Other
	HP	Hard Plaster	CT	Ceiling Tile	TR	Transite	UK	Unknown