

CES Job #	Address	Street	Regulated ACM (RACM) To Be Removed (LINFT)	Regulated ACM (RACM) To Be Removed (SQFT)	Non-Friable Asbestos Material To Be Removed (SQFT) Category I	Non-Friable Asbestos Material To Be Removed (SQFT) Category II	Non-Friable Asbestos Material Not To Be Removed (SQFT) Category I	Non-Friable Asbestos Material Not To Be Removed (SQFT) Category II	Removal Location	Material to Be Removed
119-0049	319	Read St	0.0	0.00	0.0	0.0	2,020.3	0.0	NA	NA
119-0050	304	E Virginia St	0.0	0.00	0.0	0.0	2,434.5	0.0	NA	NA
119-0051	701	N Tenth Ave	0.0	279.25	0.0	0.0	2,259.5	0.0	Basement	Duct Wrap



May 15, 2019

Ms. Jane Reel  
Evansville Department of Metropolitan Development  
Room 306 Civic Center Complex  
1 NW Martin Luther King, Jr. Blvd.  
Evansville, IN 47708-1869

RE: Asbestos Building Inspection for 304 East Virginia Street, Evansville, Indiana – Crane Project #119-0050

Dear Ms. Reel:

On April 30, 2019 Jarred Bannon of Crane Environmental Services, LLC conducted an Asbestos Building Inspection to determine if there was any Asbestos Containing Material (ACM) present at the subject property. The site is a two-story vacant house with a basement and a detached garage, which is scheduled to be demolished.

Great care was taken to account for all spaces within the building. Hidden spaces were evaluated by physical or visual inspection as reasonably accessible. Hidden spaces include inaccessible pipe chases, sub-walls behind exposed walls, layers of tile under carpet or other tile, roofing materials under impenetrable surfaces, inaccessible sections of the building, etc. All hidden layers accessible through minor alterations were observed and tested if suspected for ACM's. Some hidden areas were assumed to contain the same materials as accessible areas that were observed.

The building inspected is vacant is in disrepair and the basement and the second floor were inaccessible areas. These areas were viewed by the inspector the best way that he/she can and may have asbestos containing material that was not sampled or noted in the report. In addition, asbestos containing roofing material may be covered by other layers of roofing, leaves, or is not viewable because of the close proximity of the adjacent buildings. The notification form attached to this report has directions as to how to handle suspect asbestos containing material that is found during demolition. If additional asbestos containing material is discovered, it should be handled according to the instructions on the attached notification form. Crane will in turn issue a revised report to the owner.

Eight bulk samples and one duplicate sample of suspect asbestos containing material were collected and sent to a laboratory for analysis. None of the samples were Asbestos Containing Material (ACM) defined as any material which contains more than one percent (1%) asbestos. The laboratory results are attached, and summarized as follows:

Sample #	Material	Location	% Asbestos
1-1	Hard Plaster Wall	Kitchen	ND
1-2	Hard Plaster Wall	Living Room	ND
1-3	Hard Plaster Wall	Back Room	<1 Chrysotile
1-4	Hard Plaster Ceiling	Stairwell	ND
1-5	Hard Plaster Ceiling	Living Room	ND
1-6	Hard Plaster Ceiling	Bathroom	ND
1-7	Floor Tile & Mastic	Kitchen	ND
O-1	Asphalt Siding	Exterior Porch	ND
Dup-1 (1-1)	Hard Plaster	Kitchen	ND

ND – Non-detect

There is Regulated Asbestos Containing Material (RACM), Category I, and Category II ACM located in the house as indicated in the table below. Regulated ACM means (a) Friable asbestos material, (b) Category I non-friable ACM that has become friable, (c) Category I non-friable ACM that will be or has been subjected to sanding, grinding, cutting, or abrading, or (d) Category II non-friable ACM that has a high probability of becoming or has become crumbled, pulverized, or reduced to powder by the forces expected to act on the material during demolition or renovation operations. All floor tile, sheet vinyl flooring, asphalt roofing products, and flashing present was presumed to be Category I non-friable Asbestos Containing Material (ACM). The quantities of RACM and Category I and Category II ACM are summarized in the table below.

Location	Material	Column # 3		Column # 4		Column # 5	
		RACM To Be Removed		Category I & II Non-Friable To Be Removed		Category I & II Non-Friable Not To Be Removed	
		SqFt	CuFt	SqFt	CuFt	SqFt	CuFt
Roof	Asphalt Roofing (Assumed)	0	0	0	0	2,434.50	76.08
	<b>Total</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>2,434.50</b>	<b>76.08</b>

All quantities are approximations. Measurements were taken where permitted and estimated where measurement was not feasible.

The RACM and Category I & II Non-Friable listed in the 3<sup>rd</sup> and 4<sup>th</sup> columns above need to be removed by an Indiana Licensed Abatement Contractor prior to demolition. The Non-Friable Category I & II ACM listed in the 5<sup>th</sup> column can remain on the substrate during demolition and disposed of in the landfill.

I have attached the laboratory results, the field inspection maps and notes, and the "Notification of Demolition and Renovation Operations" with instructions to submit to IDEM prior to demolition.

If you have any questions, please call at your convenience.

Sincerely,



Jarred Bannon  
Asbestos Building Inspector #19A010835  
Expiration Date 10/4/2019

Enclosures



**Indiana Department of Environmental Management  
GUIDANCE FOR PREPARING ASBESTOS  
DEMOLITION/RENOVATION NOTIFICATIONS**

**\*\*Per Indiana Rule 326 IAC 14-10-3(1), all notifications to the IDEM must be submitted on State Form Number 44593.**

**Per 326 IAC 14-10-5, demolition/renovation fees will be assessed quarterly to owners/Operators submitting notifications during the previous quarter.**

**I.     Type of Notification -326 IAC 14-10-3(4).**

- A. If this is the original notice, please check the appropriate space on the notification form.
- B. If this is a revised notice, please check the appropriate space on the notification form. The revised notice must be postmarked and sent by certified mail, return receipt requested, at least 5 working days or delivered at least 2 working days before the start date of asbestos stripping or removal specified in: (1) the notice being revised **and** (2) the new revised notice. Facsimiles **will** be accepted by the IDEM.
- C. All revisions must include a copy of the notice being revised.
- D. If this is a canceled notice, please check the appropriate space on the notification form.
- E. Courtesy Notification

**II.    Facility Information - 326 IAC 14-10-3(3)(B) and (R)**

- A. Either the owner or operator must submit the notice.
- B. The owner means the individual(s) who own the property or lease the property.
- C. The operator means the asbestos removal contractor or demolition contractor.
- D. Specify the name, address, telephone number, Indiana license number and license expiration date, of the:
  - 1. asbestos removal contractor,
  - 2. inspector who conducted the assessment prior to demolition or renovation and
  - 3. project designer required or asbestos projects at schools K-12, or if project designer is used for non-school projects must be licensed.

**III.   Type of Operation - 326-IAC 14-10-3(3)(C), (O) and (S)**

- A. Refer to the definitions of demolition, renovation, and emergency renovation Operation in 326-IAC 14-10-2.
- B. Ordered demolitions and emergency renovation operations have additional

Notification requirements. Owner/operator must also complete Section XV or XVI of notification form.

C. Demolition by intentional burning must comply with an approved Variance from Opening Burning Regulation 326IAC 4-1.

IV. Is Asbestos Present? - Required by Federal 40 CFR Part 61, Subpart M

- A. If asbestos is present, indicate “yes” in the space provided.
- B. If asbestos is not present, indicate “no”.

V. Procedures, Including Analytical Methods, if appropriate, Used to Detect the Presence and Amount of Asbestos Material - 326 IAC 14-10-3(3)(E).

Describe how the asbestos was detected and, if samples were analyzed, specify the amount of friable asbestos visually during a walk-through inspections using a tape measure, blueprints, or pacing. Analytical methods could include the collection of samples and sample analyses by a polarized light microscope with dispersion staining.

For samples that test under 10% asbestos content: An owner or operator may (1) elect to assume material to be greater than 1% asbestos, or, (2) require verification by point counting in which the point counting result will supercede the visual estimation. Either choice and result should be stated on the notice when a sample is under 10% asbestos.

VI. Approximate Amount of Asbestos to be Removed - 326 IAC 14-10-3(3)(F)

- A. Specify the amount of regulated (friable) asbestos-containing material to be removed as follows:
  - 1. linear feet on pipes,
  - 2. square feet (surface area) on the facility components, **and**
  - 3. total cubic feet (volume) on or off all facility components. (All reported regulated amounts must be converted to cubic feet).
- B. Estimate the approximate amount of Category I and Category II non-friable asbestos-containing material in the affected part of the facility that will be removed before demolition.
- C. Estimate the approximate amount of Category I and Category II non-friable asbestos-containing material in the affected part of the facility that will not be removed before demolition.

VII. Scheduled Dates of Asbestos Stripping/Removal - 326 IAC 14-10-3(3)(H)

This means the actual start and end dates of the asbestos stripping or removal.

VIII. Scheduled Dates of Asbestos Stripping/Removal - 326 IAC 14-10-3(3)(H)

This means the starting and ending dates of the total demolition or renovation operation. For example: A renovation project may be scheduled from February 1 through March 15, 1995, however, the actual asbestos removal will occur from February 15, through 20, 1995. Demolition **must** start on date given in most recent notification.

IX. Facility Description - 326 IAC 14-10-3(3)(D) and (G)

Include the building name, floor and number of the room(s) where the asbestos stripping or removal will take place. Provide enough detail that an unfamiliar inspector can find the asbestos project without asking anyone.

X. Description of planned Demolition or Renovation Work, Methods/Techniques to be Used, and Affected Facility Components - 326 IAC 14-10-3(3)(K)

Briefly describe the methods to be used to conduct the demolition or renovation. For renovations, these methods may include gross removal, glove bag removal, hand stripping or scraping. For demolitions, methods may include a wrecking Ball, bulldozer, dynamite, or unbolting panels or sections and carefully lowering to the ground. Affected facility components may include pipe wrap, floor tile, sprayed-on insulation, transite, etc.

XI. Description of Work Practices and Engineering Controls To Be Used To Prevent Emissions of Asbestos At the Site, Including Asbestos Stripping, Removal, and Waste Handling Procedures and the Procedures to Prevent Non-Friable Asbestos Material from Becoming Friable in the Course of the Project 326 IAC 14-10-3(3)(L)

A. Examples of work practices and engineering controls to prevent asbestos emissions at the site would include: the use of water or wetting agents, containments, and negative air units during removal; placing into leak-tight containers or wrapping with six (6) mil thick polyethylene plastic sheeting which is properly labeled prior to disposal, etc.

B. Examples of removal and waste handling procedures to prevent non-friable material from becoming friable would include: removing by sections or units taking care not to crumble, pulverize, or reduce to powder, using water to prevent any emissions, placing into leak-tight containers or wrapping with six (6) mil thick plastic which is properly labeled prior to disposal (including name or waste generator and location at which the waste was generated), etc.

XII.\*\* Description of Procedures to be Followed in the Event that Unexpected Asbestos is Found or Previously Non-Friable Asbestos Material Becomes Crumbled, Pulverized or Reduced to Powder - 326 IAC 18-3 and 326 IAC 14-10-3(3)(M).

A. If the amount of unexpected asbestos or previously non-friable asbestos material is > 3 LnFt on pipes, 3 SqFt on other facility components, or a total of 0.75 CuFt on or off all facility components, then an accredited contractor (unless in-house accredited

personnel) with accredited personnel must implement the asbestos removal project in accordance with the requirements of 326 IAC 14-10.

- B. Pursuant to 326 IAC 14-10, a revised demolition/renovation notification must be submitted to the IDEM, which reflects the change in the amount of affected asbestos-containing material. The revised notice must also reflect the new asbestos removal start date, if applicable.

\*\* Required by 40 CFR Part 61, Subpart M

XIII. Waste Transporter - 326 IAC 14-10-3(3)(T)

Provide the name, address and telephone number of only the asbestos waste transporter. This should include the waste transporter's name, street address, city, state, zip code, contact person, and telephone number.

XIV. Waste Disposal site - 326 IAC 14-10-3(3)(N)

Provide the name and location of the sanitary landfill where the asbestos-containing waste material will be deposited. This should include the name, street address, city, state, zip code, waste disposal site contact person, and telephone number.

XV. If Demolition Ordered by a Governmental Agency, Identify the Agency and Attach a Copy of the Order - 326 IAC 14-10-3(3)(O)

- A. Provide the name, title and authority of the of the state or local governmental representative who has ordered the demolition .
- B. The authority is the applicable state or local regulation under which the demolition order has been issued.
- C. Attach a copy of the demolition order to the notice.

XVI. Emergency Renovations - 326 IAC 14-10-3(3)(S)

- A. Specify
  1. the date and hour that the emergency occurred,
  2. a description of the sudden unexpected event, and
  3. an explanation of how the event has caused emergency conditions
- B. An "emergency renovation operation" is a renovation operation that was not planned but results from a sudden, unexpected event. This term includes operations necessitated by non-routine failures of equipment.

XVII. Certification Statement and Signature by Owner/Operator - 326 IAC 14-10-3(3)(O) and (P)

Self-explanatory.



# INDIANA DEPARTMENT OF ENVIRONMENTAL MANAGEMENT

## NOTIFICATION OF DEMOLITION AND RENOVATION OPERATIONS

119-0050

State Form 44593 (R2 / 8-99)

<b>I. TYPE OF NOTIFICATION (check one):</b> Original _____ Revised * _____ Canceled _____ Courtesy _____ * Must include copy of notification which is being revised					
<b>II. FACILITY INFORMATION</b> (identify owner, removal contractor, demolition contractor, inspector, and project designer)					
Owner: _____					
Address: _____					
City: _____		State: _____		Zip: _____	
Contact: _____		Telephone #: _____			
Removal Contractor: _____  Address: _____  City: _____ State: _____ Zip: _____  Contact: _____ Phone: _____  IN License #: _____ Expiration: _____			Demolition Contractor: _____  Address: _____  City: _____ State: _____ Zip: _____  Contact: _____ Phone: _____		
Inspector: _____  Address: _____  City: _____ State: _____ Zip: _____  IN License #: _____ Expiration: _____  Phone: _____			(Required for asbestos projects at schools K – 12)  Project Designer: _____  Address: _____  City: _____ State: _____ Zip: _____  IN License #: _____ Expiration: _____  Phone: _____		
<b>III. TYPE OF OPERATION (check one)</b> Renovation: _____ Emergency Renovation: _____ Intentional Burning: _____ Demolition: _____ Ordered Demolition: _____					
<b>IV. IS ASBESTOS PRESENT? (check one)</b> YES: _____ NO: _____					
<b>V. PROCEDURES, INCLUDING ANALYTICAL METHODS, IF APPROPRIATE. USED TO DETECT THE PRESENCE AND AMOUNT OF ASBESTOS MATERIAL</b> _____					
<b>VI. APPROXIMATE AMOUNT OF ASBESTOS</b> (Including Regulated ACM, Category I non-friable Category II non-friable ACM)					
	Regulated ACM to be removed	Non-friable Asbestos Material To be removed		Non-friable Asbestos Material Not to be removed before demolition	
		Category I	Category II	Category I	Category II
Pipes (LnFt)					
Surface Area (SqFt)					
Total Volume (CuFt) on/off Components					
<b>VII. SCHEDULED DATES OF ASBESTOS STRIPPING/REMOVAL:</b> Start: _____ End: _____					
<b>VIII. SCHEDULED DATES OF RENOVATION:</b> Start: _____ End: _____      DEMOLITION:      Start: _____ End: _____					
<b>IX. FACILITY DESCRIPTION</b> (Including building name, floor, and room number)					
Building Name: _____					
Street Address: _____					
City: _____		State: _____		County: _____	
Location of removal within building: _____					
Building Size (SqFt): _____			# of Floors: _____		Age: _____
Present Use: _____			Prior use: _____		

X. DESCRIPTION OF PLANNED DEMOLITION OR RENOVATION WORK, METHODS/TECHNIQUES TO BE USED, AFFECTED FACILITY COMPONENTS AND TYPE OF MATERIALS REMOVED

---

---

---

---

XI. DESCRIPTION OF WORK PRACTICES AND ENGINEERING CONTROLS TO BE USED TO PREVENT EMISSIONS OF ASBESTOS AT THE SITE; INCLUDING ASBESTOS STRIPPING, REMOVAL AND WASTE HANDLING PROCEDURES TO PREVENT NON-FRIABLE ASBESTOS MATERIAL FROM BECOMING FRIABLE IN THE COURSE OF THE PROJECT:

---

---

---

XII. DESCRIPTION OF PROCEDURES TO BE FOLLOWED IN THE EVENT THAT UNEXPECTED ASBESTOS IS FOUND OR PREVIOUSLY NON-FRIABLE ASBESTOS MATERIAL BECOMES CRUMBLLED, PULVERIZED, OR REDUCED POWDER:

---

---

---

XIII. WASTE TRANSPORTER

Name: \_\_\_\_\_  
Address: \_\_\_\_\_  
City: \_\_\_\_\_ State: \_\_\_\_\_ Zip: \_\_\_\_\_  
Contact: \_\_\_\_\_ Phone: \_\_\_\_\_

XIV. WASTE DISPOSAL SITE

Name: \_\_\_\_\_  
Address: \_\_\_\_\_  
City: \_\_\_\_\_ State: \_\_\_\_\_ Zip: \_\_\_\_\_  
Contact: \_\_\_\_\_ Phone: \_\_\_\_\_

XV. IF DEMOLITION ORDERED BY A GOVERNMENT AGENCY, IDENTIFY THE AGENCY BELOW AND ATTACH A COPY OF THE ORDER TO THIS FORM. IF THE FACILITY IS NOT INSPECTED PRIOR TO DEMOLITION, THE DEBRIS MUST BE KEPT ADEQUATELY WET. THE DEBRIS MUST THEN BE INSPECTED AFTER DEMOLITION OR ASSUME ALL DEBRIS TO BE CONTAMINATED WITH RACM AND DISPOSED OF APPROPRIATELY TO COMPLY WITH 326 IAC 14-10-1(b).

Name: \_\_\_\_\_ Title: \_\_\_\_\_ Date ordered to begin: \_\_\_\_\_  
Authority: \_\_\_\_\_ Date of Order: \_\_\_\_\_

XVI. FOR EMERGENCY RENOVATIONS:

Date and time of emergency: \_\_\_\_\_

Description of sudden, unexpected event: \_\_\_\_\_

Explanation of how the event caused unsafe conditions or would cause equipment damage: \_\_\_\_\_

XVII. I HEREBY CERTIFY THAT THE INFORMATION IN THIS NOTIFICATION IS CORRECT AND THAT I WILL ONLY USE INDIANA LICENSED WORKERS AND PROJECT SUPERVISORS, TO IMPLEMENT THIS ASBESTOS PROJECT, WHICH HAVE BEEN TRAINED IN 326 IAC 14-10; 40 CFR PART 61, SUBPART M; AND, IF APPLICABLE, INDIANAPOLIS AIR POLLUTION CONTROL BOARD REGULATION 14. THE TRAINED INDIVIDUAL(S) ALONG WITH EVIDENCE THAT THE REQUIRED TRAINING WAS ACCOMPLISHED SHALL BE AVAILABLE AT THE JOB SITE DURING ACTUAL WORKING HOURS.

Owner/operator (signature)

date

Owner/operator (printed)

affiliation

\*\*\*\*\* OFFICE USE ONLY \*\*\*\*\*

POSTMARK:

RECEIVED:

REVIEWED BY:

DEFICIENCIES:

Report for:

**Ellen Mullen**  
**Crane Environmental Services, LLC**  
4209 Highway 41 North, Suite 24  
Evansville, IN 47711

---

Regarding: Project: 119-0050; 304 E. Virginia Street  
EML ID: 2151502

Approved by:



Approved Signatory  
Tracy Garcia

Dates of Analysis:  
Asbestos PLM: 05-06-2019

Service SOPs: Asbestos PLM (EPA 40CFR App E to Sub E of Part 763 & EPA METHOD 600/R-93-116, SOP EM-AS-S-1267)

---

All samples were received in acceptable condition unless noted in the Report Comments portion in the body of the report. The results relate only to the samples as received. The results include an inherent uncertainty of measurement associated with estimating percentages by polarized light microscopy. Measurement uncertainty data for sample results with >1% asbestos concentration can be provided when requested.

EMLab P&K ("the Company") shall have no liability to the client or the client's customer with respect to decisions or recommendations made, actions taken or courses of conduct implemented by either the client or the client's customer as a result of or based upon the Test Results. In no event shall the Company be liable to the client with respect to the Test Results except for the Company's own willful misconduct or gross negligence nor shall the Company be liable for incidental or consequential damages or lost profits or revenues to the fullest extent such liability may be disclaimed by law, even if the Company has been advised of the possibility of such damages, lost profits or lost revenues. In no event shall the Company's liability with respect to the Test Results exceed the amount paid to the Company by the client therefor.

Client: Crane Environmental Services, LLC  
 C/O: Ellen Mullen  
 Re: 119-0050; 304 E. Virginia Street

Date of Sampling: 04-30-2019  
 Date of Receipt: 05-01-2019  
 Date of Report: 05-06-2019

**ASBESTOS PLM REPORT****Total Samples Submitted:** 9**Total Samples Analyzed:** 9**Total Samples with Layer Asbestos Content > 1%:** 0**Location: 1-1, Hard Plaster Wall**

Lab ID-Version‡: 10203063-1

Sample Layers	Asbestos Content
Cream Skim Coat	ND
Gray Plaster	ND
Multicolored Tape	ND
<b>Composite Non-Asbestos Content:</b>	15% Cellulose
<b>Sample Composite Homogeneity:</b>	Good

**Location: 1-2, Hard Plaster Wall**

Lab ID-Version‡: 10203064-1

Sample Layers	Asbestos Content
Cream Skim Coat with Brown Paint	ND
Gray Plaster	ND
<b>Composite Non-Asbestos Content:</b>	5% Cellulose
<b>Sample Composite Homogeneity:</b>	Moderate

**Location: 1-3, Hard Plaster Wall**

Lab ID-Version‡: 10203065-1

Sample Layers	Asbestos Content
Multicolored Skim Coat	ND
Gray Plaster	ND
Off-White Compound	< 1% Chrysotile
Brown Tape	ND
<b>Composite Non-Asbestos Content:</b>	10% Cellulose
<b>Sample Composite Homogeneity:</b>	Moderate

The test report shall not be reproduced except in full, without written approval of the laboratory. The report must not be used by the client to claim product certification, approval, or endorsement by any agency of the federal government. EMLab P&K reserves the right to dispose of all samples after a period of thirty (30) days, according to all state and federal guidelines, unless otherwise specified.

Inhomogeneous samples are separated into homogeneous subsamples and analyzed individually. ND means no fibers were detected. When detected, the minimum detection and reporting limit is less than 1% unless point counting is performed. Floor tile samples may contain large amounts of interference material and it is recommended that the sample be analyzed by gravimetric point count analysis to lower the detection limit and to aid in asbestos identification.

‡ A "Version" indicated by -"x" after the Lab ID# with a value greater than 1 indicates a sample with amended data. The revision number is reflected by the value of "x".

Client: Crane Environmental Services, LLC  
 C/O: Ellen Mullen  
 Re: 119-0050; 304 E. Virginia Street

Date of Sampling: 04-30-2019  
 Date of Receipt: 05-01-2019  
 Date of Report: 05-06-2019

**ASBESTOS PLM REPORT****Location: 1-4, Hard Plaster Ceiling**

Lab ID-Version‡: 10203066-1

Sample Layers	Asbestos Content
Cream Skim Coat with Brown Paint	ND
Gray Plaster	ND
Brown Tape	ND
<b>Composite Non-Asbestos Content:</b>	15% Cellulose
<b>Sample Composite Homogeneity:</b>	Moderate

**Location: 1-5, Hard Plaster Ceiling**

Lab ID-Version‡: 10203067-1

Sample Layers	Asbestos Content
Cream Skim Coat with Brown Paint	ND
Gray Plaster	ND
Brown Tape	ND
<b>Composite Non-Asbestos Content:</b>	15% Cellulose
<b>Sample Composite Homogeneity:</b>	Moderate

**Location: 1-6, Hard Plaster Ceiling**

Lab ID-Version‡: 10203068-1

Sample Layers	Asbestos Content
Brown Skim Coat	ND
Gray Plaster	ND
Black Debris	ND
<b>Composite Non-Asbestos Content:</b>	5% Cellulose
<b>Sample Composite Homogeneity:</b>	Moderate

The test report shall not be reproduced except in full, without written approval of the laboratory. The report must not be used by the client to claim product certification, approval, or endorsement by any agency of the federal government. EMLab P&K reserves the right to dispose of all samples after a period of thirty (30) days, according to all state and federal guidelines, unless otherwise specified.

Inhomogeneous samples are separated into homogeneous subsamples and analyzed individually. ND means no fibers were detected. When detected, the minimum detection and reporting limit is less than 1% unless point counting is performed. Floor tile samples may contain large amounts of interference material and it is recommended that the sample be analyzed by gravimetric point count analysis to lower the detection limit and to aid in asbestos identification.

‡ A "Version" indicated by "-x" after the Lab ID# with a value greater than 1 indicates a sample with amended data. The revision number is reflected by the value of "x".

Client: Crane Environmental Services, LLC  
 C/O: Ellen Mullen  
 Re: 119-0050; 304 E. Virginia Street

Date of Sampling: 04-30-2019  
 Date of Receipt: 05-01-2019  
 Date of Report: 05-06-2019

**ASBESTOS PLM REPORT****Location: 1-7, Floor Tile & Mastic**

Lab ID-Version‡: 10203069-1

Sample Layers	Asbestos Content
Light Gray Ceramic Tile	ND
Multicolored Mortar	ND
Yellow Adhesive / Multicolored Paint	ND
<b>Composite Non-Asbestos Content:</b>	3% Cellulose
<b>Sample Composite Homogeneity:</b>	Moderate

**Location: O-1, Asphalt Siding**

Lab ID-Version‡: 10203070-1

Sample Layers	Asbestos Content
Black Roofing Shingle with Red Pebbles	ND
Brown Fibrous Material	ND
<b>Composite Non-Asbestos Content:</b>	65% Cellulose
<b>Sample Composite Homogeneity:</b>	Moderate

**Location: Dup-1, Hard Plaster Wall**

Lab ID-Version‡: 10203071-1

Sample Layers	Asbestos Content
Brown Tape	ND
Cream Skim Coat	ND
Gray Plaster	ND
<b>Composite Non-Asbestos Content:</b>	15% Cellulose
<b>Sample Composite Homogeneity:</b>	Moderate

The test report shall not be reproduced except in full, without written approval of the laboratory. The report must not be used by the client to claim product certification, approval, or endorsement by any agency of the federal government. EMLab P&K reserves the right to dispose of all samples after a period of thirty (30) days, according to all state and federal guidelines, unless otherwise specified.

Inhomogeneous samples are separated into homogeneous subsamples and analyzed individually. ND means no fibers were detected. When detected, the minimum detection and reporting limit is less than 1% unless point counting is performed. Floor tile samples may contain large amounts of interference material and it is recommended that the sample be analyzed by gravimetric point count analysis to lower the detection limit and to aid in asbestos identification.

‡ A "Version" indicated by "-x" after the Lab ID# with a value greater than 1 indicates a sample with amended data. The revision number is reflected by the value of "x".

**www.EMLabPK.com**

**EMLab P&K**

San Bruno, CA: 1750 Bayhill Drive, #100, San Bruno, CA 94066 • (866) 888-6653

WEATHER		Fog	Rain	Snow	Wind	Clear
LEVEL	None					
	Light					
	Moderate					
	Heavy					



002151502

## CONTACT INFORMATION

Account #: 4001

## PROJECT INFORMATION

PD Number:

TURN AROUND TIME CODES - (TAT)

WH - Weekends/Holiday

Rushes received after 2pm or on weekends, will be considered received the next business day. Please alert us in advance of weekend analysis needs.

SAMPLE ID	DESCRIPTION	Sample Type (Below)	TAT (Above)	Total Volume/Area (as applicable)	NOTES (Time of day, Temp, RH, etc.)
1-1	Hard Plaster Wall	B	STD		
1-2	Hard Plaster Wall	B	STD		
1-3	Hard Plaster Wall	B	STD		
1-4	Hard Plaster Ceiling	B	STD		
1-5	Hard Plaster Ceiling	B	STD		
1-6	Hard Plaster Ceiling	B	STD		
1-7	Floor Tile & Mastic	B	STD		
Q-1	Asphalt Siding	B	STD		
Dup-1	Hard Plaster Wall	B	STD		

### SAMPLE TYPE CODES

○ - ○ ୧୫୩

## RELINQUISHED BY

DATE &amp; TIME

Grand Bar

4/30/19 5:00 P.M.

## RECEIVED BY


DATE &amp; TIME

L. M. Gaudin

5/19/2020

By submitting this Chain of Custody, you agree to be bound by the terms and conditions set forth at [www.enlabbk.com/terms.html](http://www.enlabbk.com/terms.html)

Copyright © 2002-2008 EMLab P&K

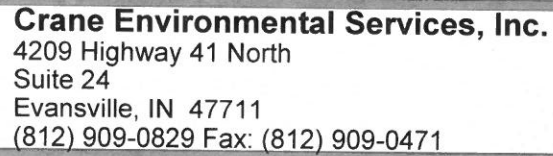

**Project:** 119-0050  
**Sampled By:** Jarred Bannon

**Location:** 304 E Virginia Street  
**Date:** 4/30/2019

<b>KEY</b>	<b>PI</b>	Pipe Insulation	<b>JC</b>	Joint Comp.	<b>FT</b>	Floor Tile	<b>CLK</b>	Caulking
	<b>PJ</b>	Pipe Joint	<b>INS</b>	Insulation	<b>ShVF</b>	Sheet Vinyl	<b>OT</b>	Other (explain)
	<b>HP</b>	Hard Plaster	<b>CT</b>	Ceiling Tile	<b>TR</b>	Transite	<b>UK</b>	Unknown



# CRANE

Crane Environmental Services, Inc.  
4209 Highway 41 North  
Suite 24  
Evansville, IN 47711  
(812) 909-0829 Fax: (812) 909-0471


## SAMPLING DIAGRAM

Project: 119-0050  
Sampled By: Jarred Bannon

Location: 304 E Virginia Street  
Date: 4/30/2019

left 1:00pm

First Floor

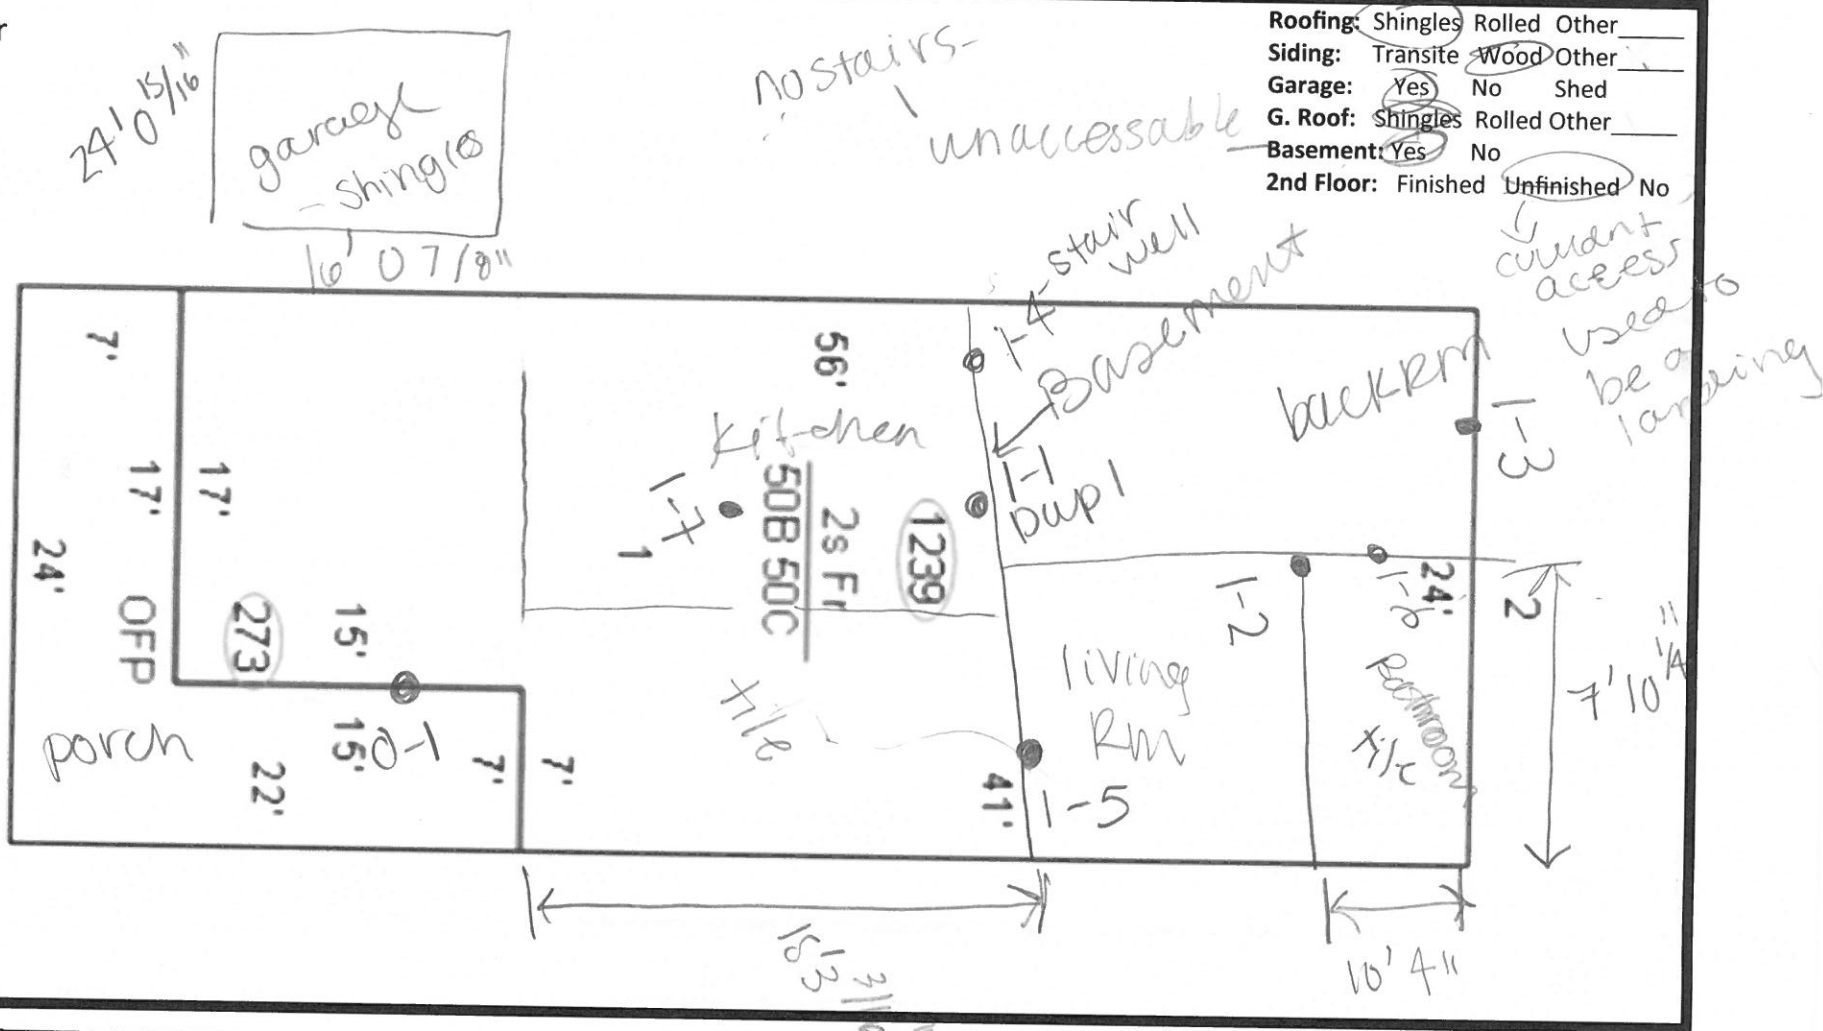

KEY	PI	Pipe Insulation	JC	Joint Comp.	FT	Floor Tile	CLK	Caulking
	PJ	Pipe Joint	INS	Insulation	ShVF	Sheet Vinyl	OT	Other
	HP	Hard Plaster	CT	Ceiling Tile	TR	Transite	UK	Unknown



May 15, 2019

Ms. Jane Reel  
Evansville Department of Metropolitan Development  
Room 306 Civic Center Complex  
1 NW Martin Luther King, Jr. Blvd.  
Evansville, IN 47708-1869

RE: Asbestos Building Inspection for 319 Read Street, Evansville, Indiana – Crane Project #119-0049

Dear Ms. Reel:

On April 30, 2019, Jarred Bannon of Crane Environmental Services, LLC conducted an Asbestos Building Inspection to determine if there was any Asbestos Containing Material (ACM) present at the subject property. The site is a one and a half story vacant house with a basement and a shed, which is scheduled to be demolished.

Great care was taken to account for all spaces within the building. Hidden spaces were evaluated by physical or visual inspection as reasonably accessible. Hidden spaces include inaccessible pipe chases, sub-walls behind exposed walls, layers of tile under carpet or other tile, roofing materials under impenetrable surfaces, inaccessible sections of the building, etc. All hidden layers accessible through minor alterations were observed and tested if suspected for ACM's. Some hidden areas were assumed to contain the same materials as accessible areas that were observed.

The building inspected is vacant and may be in disrepair and in some circumstances have inaccessible areas or areas that are dangerous to enter. These areas are viewed by the inspector the best way that he/she can and may have asbestos containing material that was not sampled or noted in the report. In addition, asbestos containing roofing material may be covered by other layers of roofing, leaves, or is not viewable because of the close proximity of the adjacent buildings. The notification form attached to this report has directions as to how to handle suspect asbestos containing material that is found during demolition. If additional asbestos containing material is discovered, it should be handled according to the instructions on the attached notification form. Crane will in turn issue a revised report to the owner.

Nine bulk samples and one duplicate sample of suspect asbestos containing material were collected and sent to a laboratory for analysis. None of the samples were Asbestos Containing Material (ACM) defined as any material which contains more than one percent (1%) asbestos. The laboratory results are attached, and summarized as follows:

Sample #	Material	Location	% Asbestos
1-1	Hard Plaster Wall	Living Room	ND
1-2	Hard Plaster Wall	Bathroom	ND
1-3	Hard Plaster Wall	Living Room	ND
1-4	Hard Plaster Ceiling	Laundry Room	ND
1-5	Hard Plaster Ceiling	Back Room	ND
1-6	Hard Plaster Ceiling	Bathroom	ND
1-7	Ceiling Tile	Living Room	ND
1-8	Ceiling Tile	Laundry Room	ND
2-1	Duct Tape	Attic	ND
Dup-1 (1-4)	Hard Plaster Ceiling	Laundry Room	ND

ND – Non-detect

There is Regulated Asbestos Containing Material (RACM), Category I, and Category II ACM located in the house as indicated in the table below. Regulated ACM means (a) Friable asbestos material, (b) Category I non-friable ACM that has become friable, (c) Category I non-friable ACM that will be or has been subjected to sanding, grinding, cutting, or abrading, or (d) Category II non-friable ACM that has a high probability of becoming or has become crumbled, pulverized, or reduced to powder by the forces expected to act on the material during demolition or renovation operations. All floor tile, sheet vinyl flooring, asphalt roofing products, and flashing present was presumed to be Category I non-friable Asbestos Containing Material (ACM). The quantities of RACM and Category I and Category II ACM are summarized in the table below.

Location	Material	Column # 3		Column # 4		Column # 5	
		RACM To Be Removed		Category I & II Non-Friable To Be Removed		Category I & II Non-Friable Not To Be Removed	
		SqFt	CuFt	SqFt	CuFt	SqFt	CuFt
Roof	Asphalt Roofing (Assumed)	0	0	0	0	1,893.00	59.20
Back Room	Floor Tile & Sheet Vinyl Flooring (Assumed)	0	0	0	0	127.25	5.30
	<b>Total</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>2020.25</b>	<b>64.50</b>

All quantities are approximations. Measurements were taken where permitted and estimated where measurement was not feasible.

The RACM and Category I & II Non-Friable listed in the 3<sup>rd</sup> and 4<sup>th</sup> columns above need to be removed by an Indiana Licensed Abatement Contractor prior to demolition. The Non-Friable Category I & II ACM listed in the 5<sup>th</sup> column can remain on the substrate during demolition and disposed of in the landfill.

I have attached the laboratory results, the field inspection maps and notes, and the "Notification of Demolition and Renovation Operations" with instructions to submit to IDEM prior to demolition.

If you have any questions, please call at your convenience.

Sincerely,



Jarred Bannon  
Asbestos Building Inspector #19A010835  
Expiration Date 10/4/2019

Enclosures



**Indiana Department of Environmental Management  
GUIDANCE FOR PREPARING ASBESTOS  
DEMOLITION/RENOVATION NOTIFICATIONS**

**\*\*Per Indiana Rule 326 IAC 14-10-3(1), all notifications to the IDEM must be submitted on State Form Number 44593.**

**Per 326 IAC 14-10-5, demolition/renovation fees will be assessed quarterly to owners/Operators submitting notifications during the previous quarter.**

**I. Type of Notification -326 IAC 14-10-3(4).**

- A. If this is the original notice, please check the appropriate space on the notification form.
- B. If this is a revised notice, please check the appropriate space on the notification form. The revised notice must be postmarked and sent by certified mail, return receipt requested, at least 5 working days or delivered at least 2 working days before the start date of asbestos stripping or removal specified in: (1) the notice being revised **and** (2) the new revised notice. Facsimiles **will** be accepted by the IDEM.
- C. All revisions must include a copy of the notice being revised.
- D. If this is a canceled notice, please check the appropriate space on the notification form.
- E. Courtesy Notification

**II. Facility Information - 326 IAC 14-10-3(3)(B) and (R)**

- A. Either the owner or operator must submit the notice.
- B. The owner means the individual(s) who own the property or lease the property.
- C. The operator means the asbestos removal contractor or demolition contractor.
- D. Specify the name, address, telephone number, Indiana license number and license expiration date, of the:
  - 1. asbestos removal contractor,
  - 2. inspector who conducted the assessment prior to demolition or renovation and
  - 3. project designer required or asbestos projects at schools K-12, or if project designer is used for non-school projects must be licensed.

**III. Type of Operation - 326-IAC 14-10-3(3)(C), (O) and (S)**

- A. Refer to the definitions of demolition, renovation, and emergency renovation Operation in 326-IAC 14-10-2.
- B. Ordered demolitions and emergency renovation operations have additional

Notification requirements. Owner/operator must also complete Section XV or XVI of notification form.

C. Demolition by intentional burning must comply with an approved Variance from Opening Burning Regulation 326IAC 4-1.

IV. Is Asbestos Present? - Required by Federal 40 CFR Part 61, Subpart M

- A. If asbestos is present, indicate “yes” in the space provided.
- B. If asbestos is not present, indicate “no”.

V. Procedures, Including Analytical Methods, if appropriate, Used to Detect the Presence and Amount of Asbestos Material - 326 IAC 14-10-3(3)(E).

Describe how the asbestos was detected and, if samples were analyzed, specify the amount of friable asbestos visually during a walk-through inspections using a tape measure, blueprints, or pacing. Analytical methods could include the collection of samples and sample analyses by a polarized light microscope with dispersion staining.

For samples that test under 10% asbestos content: An owner or operator may (1) elect to assume material to be greater than 1% asbestos, or, (2) require verification by point counting in which the point counting result will supercede the visual estimation. Either choice and result should be stated on the notice when a sample is under 10% asbestos.

VI. Approximate Amount of Asbestos to be Removed - 326 IAC 14-10-3(3)(F)

- A. Specify the amount of regulated (friable) asbestos-containing material to be removed as follows:
  - 1. linear feet on pipes,
  - 2. square feet (surface area) on the facility components, **and**
  - 3. total cubic feet (volume) on or off all facility components. (All reported regulated amounts must be converted to cubic feet).
- B. Estimate the approximate amount of Category I and Category II non-friable asbestos-containing material in the affected part of the facility that will be removed before demolition.
- C. Estimate the approximate amount of Category I and Category II non-friable asbestos-containing material in the affected part of the facility that will not be removed before demolition.

VII. Scheduled Dates of Asbestos Stripping/Removal - 326 IAC 14-10-3(3)(H)

This means the actual start and end dates of the asbestos stripping or removal.

VIII. Scheduled Dates of Asbestos Stripping/Removal - 326 IAC 14-10-3(3)(H)

This means the starting and ending dates of the total demolition or renovation operation. For example: A renovation project may be scheduled from February 1 through March 15, 1995, however, the actual asbestos removal will occur from February 15, through 20, 1995. Demolition **must** start on date given in most recent notification.

IX. Facility Description - 326 IAC 14-10-3(3)(D) and (G)

Include the building name, floor and number of the room(s) where the asbestos stripping or removal will take place. Provide enough detail that an unfamiliar inspector can find the asbestos project without asking anyone.

X. Description of planned Demolition or Renovation Work, Methods/Techniques to be Used, and Affected Facility Components - 326 IAC 14-10-3(3)(K)

Briefly describe the methods to be used to conduct the demolition or renovation. For renovations, these methods may include gross removal, glove bag removal, hand stripping or scraping. For demolitions, methods may include a wrecking Ball, bulldozer, dynamite, or unbolting panels or sections and carefully lowering to the ground. Affected facility components may include pipe wrap, floor tile, sprayed-on insulation, transite, etc.

XI. Description of Work Practices and Engineering Controls To Be Used To Prevent Emissions of Asbestos At the Site, Including Asbestos Stripping, Removal, and Waste Handling Procedures and the Procedures to Prevent Non-Friable Asbestos Material from Becoming Friable in the Course of the Project 326 IAC 14-10-3(3)(L)

A. Examples of work practices and engineering controls to prevent asbestos emissions at the site would include: the use of water or wetting agents, containments, and negative air units during removal; placing into leak-tight containers or wrapping with six (6) mil thick polyethylene plastic sheeting which is properly labeled prior to disposal, etc.

B. Examples of removal and waste handling procedures to prevent non-friable material from becoming friable would include: removing by sections or units taking care not to crumble, pulverize, or reduce to powder, using water to prevent any emissions, placing into leak-tight containers or wrapping with six (6) mil thick plastic which is properly labeled prior to disposal (including name or waste generator and location at which the waste was generated), etc.

XII.\*\* Description of Procedures to be Followed in the Event that Unexpected Asbestos is Found or Previously Non-Friable Asbestos Material Becomes Crumbled, Pulverized or Reduced to Powder - 326 IAC 18-3 and 326 IAC 14-10-3(3)(M).

A. If the amount of unexpected asbestos or previously non-friable asbestos material is > 3 LnFt on pipes, 3 SqFt on other facility components, or a total of 0.75 CuFt on or off all facility components, then an accredited contractor (unless in-house accredited

personnel) with accredited personnel must implement the asbestos removal project in accordance with the requirements of 326 IAC 14-10.

- B. Pursuant to 326 IAC 14-10, a revised demolition/renovation notification must be submitted to the IDEM, which reflects the change in the amount of affected asbestos-containing material. The revised notice must also reflect the new asbestos removal start date, if applicable.

\*\* Required by 40 CFR Part 61, Subpart M

XIII. Waste Transporter - 326 IAC 14-10-3(3)(T)

Provide the name, address and telephone number of only the asbestos waste transporter. This should include the waste transporter's name, street address, city, state, zip code, contact person, and telephone number.

XIV. Waste Disposal site - 326 IAC 14-10-3(3)(N)

Provide the name and location of the sanitary landfill where the asbestos-containing waste material will be deposited. This should include the name, street address, city, state, zip code, waste disposal site contact person, and telephone number.

XV. If Demolition Ordered by a Governmental Agency, Identify the Agency and Attach a Copy of the Order - 326 IAC 14-10-3(3)(O)

- A. Provide the name, title and authority of the of the state or local governmental representative who has ordered the demolition .
- B. The authority is the applicable state or local regulation under which the demolition order has been issued.
- C. Attach a copy of the demolition order to the notice.

XVI. Emergency Renovations - 326 IAC 14-10-3(3)(S)

- A. Specify
  1. the date and hour that the emergency occurred,
  2. a description of the sudden unexpected event, and
  3. an explanation of how the event has caused emergency conditions
- B. An "emergency renovation operation" is a renovation operation that was not planned but results from a sudden, unexpected event. This term includes operations necessitated by non-routine failures of equipment.

XVII. Certification Statement and Signature by Owner/Operator - 326 IAC 14-10-3(3)(O) and (P)

Self-explanatory.



# INDIANA DEPARTMENT OF ENVIRONMENTAL MANAGEMENT

## NOTIFICATION OF DEMOLITION AND RENOVATION OPERATIONS

119-0049

State Form 44593 (R2 / 8-99)

<b>I. TYPE OF NOTIFICATION (check one):</b> Original _____ Revised * _____ Canceled _____ Courtesy _____ * Must include copy of notification which is being revised					
<b>II. FACILITY INFORMATION</b> (identify owner, removal contractor, demolition contractor, inspector, and project designer)					
Owner: _____					
Address: _____					
City: _____		State: _____		Zip: _____	
Contact: _____		Telephone #: _____			
Removal Contractor: _____  Address: _____  City: _____ State: _____ Zip: _____  Contact: _____ Phone: _____  IN License #: _____ Expiration: _____			Demolition Contractor: _____  Address: _____  City: _____ State: _____ Zip: _____  Contact: _____ Phone: _____		
Inspector: _____  Address: _____  City: _____ State: _____ Zip: _____  IN License #: _____ Expiration: _____  Phone: _____			(Required for asbestos projects at schools K – 12)  Project Designer: _____  Address: _____  City: _____ State: _____ Zip: _____  IN License #: _____ Expiration: _____  Phone: _____		
<b>III. TYPE OF OPERATION (check one)</b> Renovation: _____ Emergency Renovation: _____ Intentional Burning: _____ Demolition: _____ Ordered Demolition: _____					
<b>IV. IS ASBESTOS PRESENT? (check one)</b> YES: _____ NO: _____					
<b>V. PROCEDURES, INCLUDING ANALYTICAL METHODS, IF APPROPRIATE. USED TO DETECT THE PRESENCE AND AMOUNT OF ASBESTOS MATERIAL</b> _____					
<b>VI. APPROXIMATE AMOUNT OF ASBESTOS</b> (Including Regulated ACM, Category I non-friable Category II non-friable ACM)					
	Regulated ACM to be removed	Non-friable Asbestos Material To be removed		Non-friable Asbestos Material Not to be removed before demolition	
		Category I	Category II	Category I	Category II
Pipes (LnFt)					
Surface Area (SqFt)					
Total Volume (CuFt) on/off Components					
<b>VII. SCHEDULED DATES OF ASBESTOS STRIPPING/REMOVAL:</b> Start: _____ End: _____					
<b>VIII. SCHEDULED DATES OF RENOVATION:</b> Start: _____ End: _____      DEMOLITION:      Start: _____ End: _____					
<b>IX. FACILITY DESCRIPTION</b> (Including building name, floor, and room number)					
Building Name: _____					
Street Address: _____					
City: _____		State: _____		County: _____	
Location of removal within building: _____					
Building Size (SqFt): _____			# of Floors: _____		Age: _____
Present Use: _____			Prior use: _____		

X. DESCRIPTION OF PLANNED DEMOLITION OR RENOVATION WORK, METHODS/TECHNIQUES TO BE USED, AFFECTED FACILITY COMPONENTS AND TYPE OF MATERIALS REMOVED

\_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_

XI. DESCRIPTION OF WORK PRACTICES AND ENGINEERING CONTROLS TO BE USED TO PREVENT EMISSIONS OF ASBESTOS AT THE SITE; INCLUDING ASBESTOS STRIPPING, REMOVAL AND WASTE HANDLING PROCEDURES TO PREVENT NON-FRIABLE ASBESTOS MATERIAL FROM BECOMING FRIABLE IN THE COURSE OF THE PROJECT:

\_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_

XII. DESCRIPTION OF PROCEDURES TO BE FOLLOWED IN THE EVENT THAT UNEXPECTED ASBESTOS IS FOUND OR PREVIOUSLY NON-FRIABLE ASBESTOS MATERIAL BECOMES CRUMBLLED, PULVERIZED, OR REDUCED POWDER:

\_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_

XIII. WASTE TRANSPORTER

Name: \_\_\_\_\_  
Address: \_\_\_\_\_  
City: \_\_\_\_\_ State: \_\_\_\_\_ Zip: \_\_\_\_\_  
Contact: \_\_\_\_\_ Phone: \_\_\_\_\_

XIV. WASTE DISPOSAL SITE

Name: \_\_\_\_\_  
Address: \_\_\_\_\_  
City: \_\_\_\_\_ State: \_\_\_\_\_ Zip: \_\_\_\_\_  
Contact: \_\_\_\_\_ Phone: \_\_\_\_\_

XV. IF DEMOLITION ORDERED BY A GOVERNMENT AGENCY, IDENTIFY THE AGENCY BELOW AND ATTACH A COPY OF THE ORDER TO THIS FORM. IF THE FACILITY IS NOT INSPECTED PRIOR TO DEMOLITION, THE DEBRIS MUST BE KEPT ADEQUATELY WET. THE DEBRIS MUST THEN BE INSPECTED AFTER DEMOLITION OR ASSUME ALL DEBRIS TO BE CONTAMINATED WITH RACM AND DISPOSED OF APPROPRIATELY TO COMPLY WITH 326 IAC 14-10-1(b).

Name: \_\_\_\_\_ Title: \_\_\_\_\_ Date ordered to begin: \_\_\_\_\_  
Authority: \_\_\_\_\_ Date of Order: \_\_\_\_\_

XVI. FOR EMERGENCY RENOVATIONS:

Date and time of emergency: \_\_\_\_\_

Description of sudden, unexpected event: \_\_\_\_\_

Explanation of how the event caused unsafe conditions or would cause equipment damage: \_\_\_\_\_

XVII. I HEREBY CERTIFY THAT THE INFORMATION IN THIS NOTIFICATION IS CORRECT AND THAT I WILL ONLY USE INDIANA LICENSED WORKERS AND PROJECT SUPERVISORS, TO IMPLEMENT THIS ASBESTOS PROJECT, WHICH HAVE BEEN TRAINED IN 326IAC 14-10; 40 CFR PART 61, SUBPART M; AND, IF APPLICABLE, INDIANAPOLIS AIR POLLUTION CONTROL BOARD REGULATION 14. THE TRAINED INDIVIDUAL(S) ALONG WITH EVIDENCE THAT THE REQUIRED TRAINING WAS ACCOMPLISHED SHALL BE AVAILABLE AT THE JOB SITE DURING ACTUAL WORKING HOURS.

Owner/operator (signature)

date

Owner/operator (printed)

affiliation

\*\*\*\*\* OFFICE USE ONLY \*\*\*\*\*

POSTMARK:

RECEIVED:

REVIEWED BY:

DEFICIENCIES:

Report for:

**Ellen Mullen**  
**Crane Environmental Services, LLC**  
4209 Highway 41 North, Suite 24  
Evansville, IN 47711

---

Regarding: Project: 119-0049; 319 Read Street  
EML ID: 2151499

Approved by:



Approved Signatory  
Tracy Garcia

Dates of Analysis:  
Asbestos PLM: 05-06-2019

Service SOPs: Asbestos PLM (EPA 40CFR App E to Sub E of Part 763 & EPA METHOD 600/R-93-116, SOP EM-AS-S-1267)

---

All samples were received in acceptable condition unless noted in the Report Comments portion in the body of the report. The results relate only to the samples as received. The results include an inherent uncertainty of measurement associated with estimating percentages by polarized light microscopy. Measurement uncertainty data for sample results with >1% asbestos concentration can be provided when requested.

EMLab P&K ("the Company") shall have no liability to the client or the client's customer with respect to decisions or recommendations made, actions taken or courses of conduct implemented by either the client or the client's customer as a result of or based upon the Test Results. In no event shall the Company be liable to the client with respect to the Test Results except for the Company's own willful misconduct or gross negligence nor shall the Company be liable for incidental or consequential damages or lost profits or revenues to the fullest extent such liability may be disclaimed by law, even if the Company has been advised of the possibility of such damages, lost profits or lost revenues. In no event shall the Company's liability with respect to the Test Results exceed the amount paid to the Company by the client therefor.

Client: Crane Environmental Services, LLC  
 C/O: Ellen Mullen  
 Re: 119-0049; 319 Read Street

Date of Sampling: 04-30-2019  
 Date of Receipt: 05-01-2019  
 Date of Report: 05-06-2019

**ASBESTOS PLM REPORT****Total Samples Submitted:** 10**Total Samples Analyzed:** 10**Total Samples with Layer Asbestos Content > 1%:** 0**Location: 1-1, Hard Plaster Wall**

Lab ID-Version‡: 10203009-1

Sample Layers	Asbestos Content
Multicolored Plaster	ND
<b>Composite Non-Asbestos Content:</b>	4% Cellulose
<b>Sample Composite Homogeneity:</b>	Good

**Location: 1-2, Hard Plaster Wall**

Lab ID-Version‡: 10203010-1

Sample Layers	Asbestos Content
Multicolored Plaster	ND
<b>Composite Non-Asbestos Content:</b>	4% Cellulose
<b>Sample Composite Homogeneity:</b>	Good

**Location: 1-3, Hard Plaster Wall**

Lab ID-Version‡: 10203011-1

Sample Layers	Asbestos Content
Gray Plaster	ND
<b>Composite Non-Asbestos Content:</b>	5% Cellulose
<b>Sample Composite Homogeneity:</b>	Moderate

**Location: 1-4, Hard Plaster Ceiling**

Lab ID-Version‡: 10203012-1

Sample Layers	Asbestos Content
Gray Plaster	ND
Black Debris	ND
<b>Composite Non-Asbestos Content:</b>	5% Cellulose
<b>Sample Composite Homogeneity:</b>	Moderate

The test report shall not be reproduced except in full, without written approval of the laboratory. The report must not be used by the client to claim product certification, approval, or endorsement by any agency of the federal government. EMLab P&K reserves the right to dispose of all samples after a period of thirty (30) days, according to all state and federal guidelines, unless otherwise specified.

Inhomogeneous samples are separated into homogeneous subsamples and analyzed individually. ND means no fibers were detected. When detected, the minimum detection and reporting limit is less than 1% unless point counting is performed. Floor tile samples may contain large amounts of interference material and it is recommended that the sample be analyzed by gravimetric point count analysis to lower the detection limit and to aid in asbestos identification.

‡ A "Version" indicated by "-x" after the Lab ID# with a value greater than 1 indicates a sample with amended data. The revision number is reflected by the value of "x".

Client: Crane Environmental Services, LLC  
 C/O: Ellen Mullen  
 Re: 119-0049; 319 Read Street

Date of Sampling: 04-30-2019  
 Date of Receipt: 05-01-2019  
 Date of Report: 05-06-2019

**ASBESTOS PLM REPORT****Location: 1-5, Hard Plaster Ceiling**

Lab ID-Version‡: 10203013-1

Sample Layers	Asbestos Content
Cream Skim Coat with Black Paint	ND
Gray Plaster	ND
<b>Composite Non-Asbestos Content:</b>	5% Cellulose
<b>Sample Composite Homogeneity:</b>	Moderate

**Location: 1-6, Hard Plaster Ceiling**

Lab ID-Version‡: 10203014-1

Sample Layers	Asbestos Content
Tan Skim Coat	ND
Gray Plaster	ND
Black Debris	ND
<b>Composite Non-Asbestos Content:</b>	5% Cellulose
<b>Sample Composite Homogeneity:</b>	Moderate

**Location: 1-7, Ceiling Tile**

Lab ID-Version‡: 10203015-1

Sample Layers	Asbestos Content
Gray Ceiling Tile with White Surface	ND
<b>Composite Non-Asbestos Content:</b>	35% Cellulose 20% Mineral Wool
<b>Sample Composite Homogeneity:</b>	Good

**Location: 1-8, Ceiling Tile**

Lab ID-Version‡: 10203016-1

Sample Layers	Asbestos Content
Gray Ceiling Tile with White Surface	ND
<b>Composite Non-Asbestos Content:</b>	35% Cellulose 20% Mineral Wool
<b>Sample Composite Homogeneity:</b>	Good

The test report shall not be reproduced except in full, without written approval of the laboratory. The report must not be used by the client to claim product certification, approval, or endorsement by any agency of the federal government. EMLab P&K reserves the right to dispose of all samples after a period of thirty (30) days, according to all state and federal guidelines, unless otherwise specified.

Inhomogeneous samples are separated into homogeneous subsamples and analyzed individually. ND means no fibers were detected. When detected, the minimum detection and reporting limit is less than 1% unless point counting is performed. Floor tile samples may contain large amounts of interference material and it is recommended that the sample be analyzed by gravimetric point count analysis to lower the detection limit and to aid in asbestos identification.

‡ A "Version" indicated by "-x" after the Lab ID# with a value greater than 1 indicates a sample with amended data. The revision number is reflected by the value of "x".

Client: Crane Environmental Services, LLC  
 C/O: Ellen Mullen  
 Re: 119-0049; 319 Read Street

Date of Sampling: 04-30-2019  
 Date of Receipt: 05-01-2019  
 Date of Report: 05-06-2019

**ASBESTOS PLM REPORT****Location: 2-1, Duct Tape**

Lab ID-Version‡: 10203017-1

Sample Layers	Asbestos Content
Semi-Transparent Adhesive / Multicolored Duct Tape	ND
<b>Sample Composite Homogeneity:</b>	Moderate

**Location: Dup-1, Hard Plaster Ceiling**

Lab ID-Version‡: 10203018-1

Sample Layers	Asbestos Content
Black Debris	ND
Gray Plaster	ND
<b>Composite Non-Asbestos Content:</b>	5% Cellulose
<b>Sample Composite Homogeneity:</b>	Moderate

The test report shall not be reproduced except in full, without written approval of the laboratory. The report must not be used by the client to claim product certification, approval, or endorsement by any agency of the federal government. EMLab P&K reserves the right to dispose of all samples after a period of thirty (30) days, according to all state and federal guidelines, unless otherwise specified.

Inhomogeneous samples are separated into homogeneous subsamples and analyzed individually. ND means no fibers were detected. When detected, the minimum detection and reporting limit is less than 1% unless point counting is performed. Floor tile samples may contain large amounts of interference material and it is recommended that the sample be analyzed by gravimetric point count analysis to lower the detection limit and to aid in asbestos identification.

‡ A "Version" indicated by "-x" after the Lab ID# with a value greater than 1 indicates a sample with amended data. The revision number is reflected by the value of "x".

## CHAIN OF CUSTODY

www.EMLabPK.com



EMLab P&amp;K

Cherry Hill, NJ 1936 Olney Avenue, Cherry Hill, NJ 08003 • (856) 871-1984  
 Phoenix, AZ 1501 West Knudsen Drive, Phoenix, AZ 85027 • (800) 651-4802  
 San Bruno, CA 1150 Bayhill Drive, #100, San Bruno, CA 94066 • (866) 888-6653

WEATHER		Fog	Rain	Snow	Wind	Clear
LEVEL	None					
	Light					
	Moderate					
	Heavy					



002151499

CONTACT INFORMATION	
Company: Crane Environmental Services, LLC	Address: 1120 Star Gate Court, Evansville, IN 47725
Contact: Ellen R. Mullen	Special Instructions:
Phone: (812) 868-0709	Account #: 4001


PROJECT INFORMATION		TURN AROUND TIME CODES - (TAT)	
Project ID: 119-0049		STD - Standard (DEFAULT)	Rushes received after 2pm or on weekends, will be considered received the next business day. Please alert us in advance of weekend analysis needs.
Project Desc: 319 Read Street		ND - Next Business Day	
Project Zip Code: 47710	Sampling Date & Time: 4/30/2018 1:00 p.m.	SD - Same Business Day Rush	
PO Number:		WH - Weekend/Holiday	

SAMPLE ID	DESCRIPTION	Sample Type (Below)	TAT (Above)	Total Volume/Area (as applicable)	NOTES (Time of day, Temp, RH, etc.)
1-1	Hard Plaster Wall	B	STD		
1-2	Hard Plaster Wall	B	STD		
1-3	Hard Plaster Wall	B	STD		
1-4	Hard Plaster Ceiling	B	STD		
1-5	Hard Plaster Ceiling	B	STD		
1-6	Hard Plaster Ceiling	B	STD		
1-7	Ceiling Tile	B	STD		
1-8	Ceiling Tile	B	STD		
2-1	Dust Tape	B	STD		
Dup-1	Hard Plaster Ceiling	B	STD		

SAMPLE TYPE CODES				RELINQUISHED BY	DATE & TIME
BC - BioCassette™	CP - Contact Plate	T - Tape	D - Dust	Jana Ba...	4/30/18 5:00 P.M.
ATS - Andersen	ST - Spore Trap: Zefon, Allergenco, Burkard,...	SW - Swab	W - Water		
SAS - Surface Air Sampler		B - Bulk	SO - Soil		
O - Other					

REQUESTED SERVICE	
Non-Culturable	Culturable
Spore Trap	Tape Swab Bulk
BioCassette™ Andersen, Wason, Bulk, Dust, Soil, Contact Plate	
Fungi - Spore Trap Analysis	
Spore Trap Analysis - Other particles	
Direct Microscopic Exam (Qualitative)	
Quantitative Spore Count Direct Exam	
1-Media Surface Fungi (Genus ID + Asp. spp.)	
2-Media Surface Fungi (Genus ID + Asp. spp.)	
3-Media Surface Fungi (Genus ID + Asp. spp.)	
Culturable Air Fungi (Genus ID + Asp. spp.)	
Gram Stain and Counts (Culturable Air and Surface Bacteria)	
Legionella culture	
Total Coliform, E. coli (Presence/Absence)	
Membrane Filtration (Please specify organism)	
MPS Bacteria (Please specify organism)	
QuantTray - Sewage Screen	
Asbestos Analysis - PCM Airborne Fiber Count (NIOSH 7400)	
Asbestos Analysis - PCM (EPA method 600/R-93-116)	
PCR (Please specify test)	

By submitting this Chain of Custody, you agree to be bound by the terms and conditions set forth at [www.emlabpk.com/terms.html](http://www.emlabpk.com/terms.html)  
 Copyright © 2002-2008 EMLab P&K

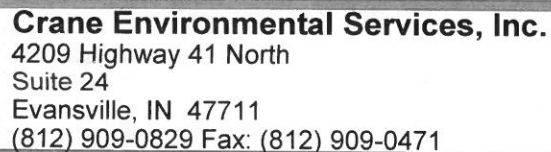

# CHAIN OF CUSTODY

**Project:** 119-0049  
**Sampled By:** Jarred Bannon

**Location:** 319 Read Street  
**Date:** 4/30/2019

[illegible]

<b>KEY</b>	<b>PI</b>	Pipe Insulation	<b>JC</b>	Joint Comp.	<b>FT</b>	Floor Tile	<b>CLK</b>	Caulking
	<b>PJ</b>	Pipe Joint	<b>INS</b>	Insulation	<b>ShVF</b>	Sheet Vinyl	<b>OT</b>	Other (explain)
	<b>HP</b>	Hard Plaster	<b>CT</b>	Ceiling Tile	<b>TR</b>	Transite	<b>UK</b>	Unknown



# CRANE

**Crane Environmental Services, Inc.**

4209 Highway 41 North  
Suite 24  
Evansville, IN 47711  
(812) 909-0829 Fax: (812) 909-0471

# SAMPLING DIAGRAM

**Project:** 119-0049  
**Sampled By:** Jarred Bannon


**Location:** 319 Read Street  
**Date:** 4/30/2019

1st 1.46

First Floor

**Roofing:** Shingles ☒ Rolled ☐ Other ☐  
**Siding:** Transite ☒ Wood ☐ Other ☐  
**Garage:** Yes ☐ No ☒ Shed - metal  
**G. Roof:** Shingles ☒ Rolled ☐ Other ☐  
**Basement:** Yes ☒ No ☐  
**2nd Floor:** Finished ☒ Unfinished ☐ No ☐

1/2 attic

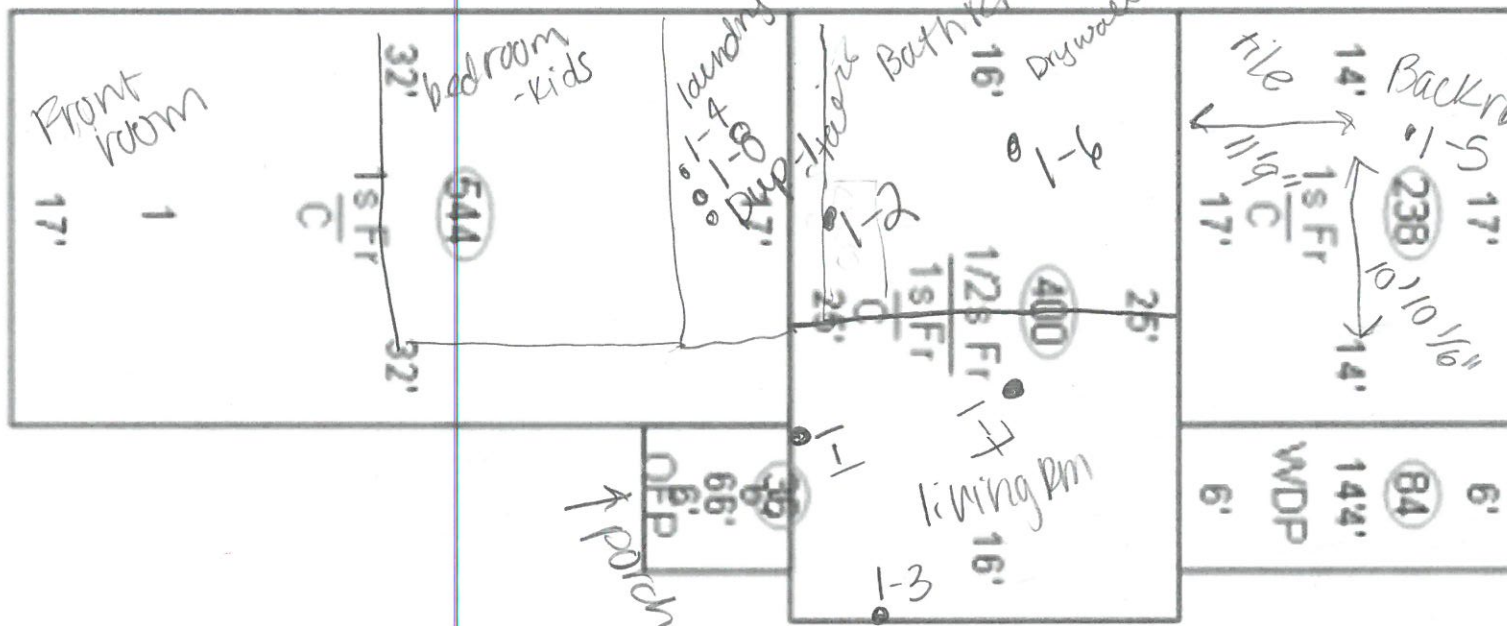

KEY	PI	Pipe Insulation	JC	Joint Comp.	FT	Floor Tile	CLK	Caulking
	PJ	Pipe Joint	INS	Insulation	ShVF	Sheet Vinyl	OT	Other
	HP	Hard Plaster	CT	Ceiling Tile	TR	Transite	UK	Unknown



May 15, 2019

Ms. Jane Reel  
Evansville Department of Metropolitan Development  
Room 306 Civic Center Complex  
1 NW Martin Luther King, Jr. Blvd.  
Evansville, IN 47708-1869

RE: Asbestos Building Inspection for 701 North Tenth Avenue, Evansville, Indiana – Crane Project #119-0051

Dear Ms. Reel:

On April 30, 2019 Jarred Bannon of Crane Environmental Services, LLC conducted an Asbestos Building Inspection to determine if there was any Asbestos Containing Material (ACM) present at the subject property. The site is a one and a half story vacant house with a basement and a detached garage, which is scheduled to be demolished.

Great care was taken to account for all spaces within the building. Hidden spaces were evaluated by physical or visual inspection as reasonably accessible. Hidden spaces include inaccessible pipe chases, sub-walls behind exposed walls, layers of tile under carpet or other tile, roofing materials under impenetrable surfaces, inaccessible sections of the building, etc. All hidden layers accessible through minor alterations were observed and tested if suspected for ACM's. Some hidden areas were assumed to contain the same materials as accessible areas that were observed.

The building inspected is vacant and may be in disrepair and in some circumstances have inaccessible areas or areas that are dangerous to enter. These areas are viewed by the inspector the best way that he/she can and may have asbestos containing material that was not sampled or noted in the report. In addition, asbestos containing roofing material may be covered by other layers of roofing, leaves, or is not viewable because of the close proximity of the adjacent buildings. The notification form attached to this report has directions as to how to handle suspect asbestos containing material that is found during demolition. If additional asbestos containing material is discovered, it should be handled according to the instructions on the attached notification form. Crane will in turn issue a revised report to the owner.

Twenty bulk samples and two duplicate samples of suspect asbestos containing material were collected and sent to a laboratory for analysis. One of the samples was Asbestos Containing Material (ACM) defined as any material which contains more than one percent (1%) asbestos. The laboratory results are attached, and summarized as follows:

Sample #	Material	Location	% Asbestos
1-1	Hard Plaster Wall	Office	ND
1-2	Hard Plaster Wall	Office	ND
1-3	Hard Plaster Wall	Living Room	ND
1-4	Hard Plaster Ceiling	Kitchen	ND
1-5	Hard Plaster Ceiling	Office	ND
1-6	Hard Plaster Ceiling	Back Room	ND
1-7	Ceiling Tile	Kitchen	ND
EX-1	Asphalt Siding	Exterior	ND
EX-2	Asphalt Siding	Exterior	ND
1-8	Duct Tape	Living Room	ND
1-9	Ceiling Tile	Back Room	ND
B-1	Duct Wrap	Basement	70 Chrysotile
B-2	Duct Tape	Basement	ND
2-1	Hard Plaster Wall	Back Room (Upstairs)	ND
2-2	Hard Plaster Wall	Back Room (Upstairs)	ND
2-3	Hard Plaster Wall	Back Room (Upstairs)	ND
2-4	Hard Plaster Ceiling	Back Room (Upstairs)	ND
2-5	Hard Plaster Ceiling	Back Room (Upstairs)	ND
2-6	Hard Plaster Ceiling	Back Room (Upstairs)	ND
2-7	Ceiling Tile	Back Room (Upstairs)	ND
Dup-1 (1-1)	Hard Plaster Wall	Office	ND
Dup-2 (2-6)	Hard Plaster Ceiling	Back Room (Upstairs)	ND

ND – Non-detect

There is Regulated Asbestos Containing Material (RACM), Category I, and Category II ACM located in the house as indicated in the table below. Regulated ACM means (a) Friable asbestos material, (b) Category I non-friable ACM that has become friable, (c) Category I non-friable ACM that will be or has been subjected to sanding, grinding, cutting, or abrading, or (d) Category II non-friable ACM that has a high probability of becoming or has become crumbled, pulverized, or reduced to powder by the forces expected to act on the material during demolition or renovation operations. All floor tile, sheet vinyl flooring, asphalt roofing products, and flashing present was presumed to be Category I non-friable Asbestos Containing Material (ACM). The quantities of RACM and Category I and Category II ACM are summarized in the table below.

Location	Material	Column # 3		Column # 4		Column # 5	
		RACM To Be Removed		Category I & II Non-Friable To Be Removed		Category I & II Non- Friable Not To Be Removed	
		SqFt	CuF t	SqFt	CuFt	SqFt	CuFt
Roof	Asphalt Roofing (Assumed)	0	0	0	0	2,034.00	63.56
Bathroom, Kitchen, Living Room Entry	Floor Tile & Sheet Vinyl Flooring (Assumed)	0	0	0	0	225.49	9.40
Basement	Duct Wrap	279.3	66.9	0	0	0	0
	<b>Total</b>	<b>279.3</b>	<b>66.9</b>	<b>0</b>	<b>0</b>	<b>2,259.49</b>	<b>72.96</b>

All quantities are approximations. Measurements were taken where permitted and estimated where measurement was not feasible.

The RACM and Category I & II Non-Friable listed in the 3<sup>rd</sup> and 4<sup>th</sup> columns above need to be removed by an Indiana Licensed Abatement Contractor prior to demolition. The Non-Friable Category I & II ACM listed in the 5<sup>th</sup> column can remain on the substrate during demolition and disposed of in the landfill.

I have attached the laboratory results, the field inspection maps and notes, and the "Notification of Demolition and Renovation Operations" with instructions to submit to IDEM prior to demolition.

If you have any questions, please call at your convenience.

Sincerely,



Jarred Bannon  
Asbestos Building Inspector #19A010835  
Expiration Date 10/4/2019

Enclosures

**Indiana Department of Environmental Management  
GUIDANCE FOR PREPARING ASBESTOS  
DEMOLITION/RENOVATION NOTIFICATIONS**

**\*\*Per Indiana Rule 326 IAC 14-10-3(1), all notifications to the IDEM must be submitted on State Form Number 44593.**

**Per 326 IAC 14-10-5, demolition/renovation fees will be assessed quarterly to owners/Operators submitting notifications during the previous quarter.**

**I.     Type of Notification -326 IAC 14-10-3(4).**

- A. If this is the original notice, please check the appropriate space on the notification form.
- B. If this is a revised notice, please check the appropriate space on the notification form. The revised notice must be postmarked and sent by certified mail, return receipt requested, at least 5 working days or delivered at least 2 working days before the start date of asbestos stripping or removal specified in: (1) the notice being revised **and** (2) the new revised notice. Facsimiles **will** be accepted by the IDEM.
- C. All revisions must include a copy of the notice being revised.
- D. If this is a canceled notice, please check the appropriate space on the notification form.
- E. Courtesy Notification

**II.    Facility Information - 326 IAC 14-10-3(3)(B) and (R)**

- A. Either the owner or operator must submit the notice.
- B. The owner means the individual(s) who own the property or lease the property.
- C. The operator means the asbestos removal contractor or demolition contractor.
- D. Specify the name, address, telephone number, Indiana license number and license expiration date, of the:
  - 1. asbestos removal contractor,
  - 2. inspector who conducted the assessment prior to demolition or renovation and
  - 3. project designer required or asbestos projects at schools K-12, or if project designer is used for non-school projects must be licensed.

**III.   Type of Operation - 326-IAC 14-10-3(3)(C), (O) and (S)**

- A. Refer to the definitions of demolition, renovation, and emergency renovation Operation in 326-IAC 14-10-2.
- B. Ordered demolitions and emergency renovation operations have additional

Notification requirements. Owner/operator must also complete Section XV or XVI of notification form.

C. Demolition by intentional burning must comply with an approved Variance from Opening Burning Regulation 326IAC 4-1.

IV. Is Asbestos Present? - Required by Federal 40 CFR Part 61, Subpart M

- A. If asbestos is present, indicate “yes” in the space provided.
- B. If asbestos is not present, indicate “no”.

V. Procedures, Including Analytical Methods, if appropriate, Used to Detect the Presence and Amount of Asbestos Material - 326 IAC 14-10-3(3)(E).

Describe how the asbestos was detected and, if samples were analyzed, specify the amount of friable asbestos visually during a walk-through inspections using a tape measure, blueprints, or pacing. Analytical methods could include the collection of samples and sample analyses by a polarized light microscope with dispersion staining.

For samples that test under 10% asbestos content: An owner or operator may (1) elect to assume material to be greater than 1% asbestos, or, (2) require verification by point counting in which the point counting result will supercede the visual estimation. Either choice and result should be stated on the notice when a sample is under 10% asbestos.

VI. Approximate Amount of Asbestos to be Removed - 326 IAC 14-10-3(3)(F)

- A. Specify the amount of regulated (friable) asbestos-containing material to be removed as follows:
  - 1. linear feet on pipes,
  - 2. square feet (surface area) on the facility components, **and**
  - 3. total cubic feet (volume) on or off all facility components. (All reported regulated amounts must be converted to cubic feet).
- B. Estimate the approximate amount of Category I and Category II non-friable asbestos-containing material in the affected part of the facility that will be removed before demolition.
- C. Estimate the approximate amount of Category I and Category II non-friable asbestos-containing material in the affected part of the facility that will not be removed before demolition.

VII. Scheduled Dates of Asbestos Stripping/Removal - 326 IAC 14-10-3(3)(H)

This means the actual start and end dates of the asbestos stripping or removal.

VIII. Scheduled Dates of Asbestos Stripping/Removal - 326 IAC 14-10-3(3)(H)

This means the starting and ending dates of the total demolition or renovation operation. For example: A renovation project may be scheduled from February 1 through March 15, 1995, however, the actual asbestos removal will occur from February 15, through 20, 1995. Demolition **must** start on date given in most recent notification.

IX. Facility Description - 326 IAC 14-10-3(3)(D) and (G)

Include the building name, floor and number of the room(s) where the asbestos stripping or removal will take place. Provide enough detail that an unfamiliar inspector can find the asbestos project without asking anyone.

X. Description of planned Demolition or Renovation Work, Methods/Techniques to be Used, and Affected Facility Components - 326 IAC 14-10-3(3)(K)

Briefly describe the methods to be used to conduct the demolition or renovation. For renovations, these methods may include gross removal, glove bag removal, hand stripping or scraping. For demolitions, methods may include a wrecking Ball, bulldozer, dynamite, or unbolting panels or sections and carefully lowering to the ground. Affected facility components may include pipe wrap, floor tile, sprayed-on insulation, transite, etc.

XI. Description of Work Practices and Engineering Controls To Be Used To Prevent Emissions of Asbestos At the Site, Including Asbestos Stripping, Removal, and Waste Handling Procedures and the Procedures to Prevent Non-Friable Asbestos Material from Becoming Friable in the Course of the Project 326 IAC 14-10-3(3)(L)

A. Examples of work practices and engineering controls to prevent asbestos emissions at the site would include: the use of water or wetting agents, containments, and negative air units during removal; placing into leak-tight containers or wrapping with six (6) mil thick polyethylene plastic sheeting which is properly labeled prior to disposal, etc.

B. Examples of removal and waste handling procedures to prevent non-friable material from becoming friable would include: removing by sections or units taking care not to crumble, pulverize, or reduce to powder, using water to prevent any emissions, placing into leak-tight containers or wrapping with six (6) mil thick plastic which is properly labeled prior to disposal (including name or waste generator and location at which the waste was generated), etc.

XII.\*\* Description of Procedures to be Followed in the Event that Unexpected Asbestos is Found or Previously Non-Friable Asbestos Material Becomes Crumbled, Pulverized or Reduced to Powder - 326 IAC 18-3 and 326 IAC 14-10-3(3)(M).

A. If the amount of unexpected asbestos or previously non-friable asbestos material is > 3 LnFt on pipes, 3 SqFt on other facility components, or a total of 0.75 CuFt on or off all facility components, then an accredited contractor (unless in-house accredited



personnel) with accredited personnel must implement the asbestos removal project in accordance with the requirements of 326 IAC 14-10.

- B. Pursuant to 326 IAC 14-10, a revised demolition/renovation notification must be submitted to the IDEM, which reflects the change in the amount of affected asbestos-containing material. The revised notice must also reflect the new asbestos removal start date, if applicable.

\*\* Required by 40 CFR Part 61, Subpart M

XIII. Waste Transporter - 326 IAC 14-10-3(3)(T)

Provide the name, address and telephone number of only the asbestos waste transporter. This should include the waste transporter's name, street address, city, state, zip code, contact person, and telephone number.

XIV. Waste Disposal site - 326 IAC 14-10-3(3)(N)

Provide the name and location of the sanitary landfill where the asbestos-containing waste material will be deposited. This should include the name, street address, city, state, zip code, waste disposal site contact person, and telephone number.

XV. If Demolition Ordered by a Governmental Agency, Identify the Agency and Attach a Copy of the Order - 326 IAC 14-10-3(3)(O)

- A. Provide the name, title and authority of the of the state or local governmental representative who has ordered the demolition .
- B. The authority is the applicable state or local regulation under which the demolition order has been issued.
- C. Attach a copy of the demolition order to the notice.

XVI. Emergency Renovations - 326 IAC 14-10-3(3)(S)

- A. Specify
  1. the date and hour that the emergency occurred,
  2. a description of the sudden unexpected event, and
  3. an explanation of how the event has caused emergency conditions
- B. An "emergency renovation operation" is a renovation operation that was not planned but results from a sudden, unexpected event. This term includes operations necessitated by non-routine failures of equipment.

XVII. Certification Statement and Signature by Owner/Operator - 326 IAC 14-10-3(3)(O) and (P)

Self-explanatory.



# INDIANA DEPARTMENT OF ENVIRONMENTAL MANAGEMENT

## NOTIFICATION OF DEMOLITION AND RENOVATION OPERATIONS

119-0051

State Form 44593 (R2 / 8-99)

<b>I. TYPE OF NOTIFICATION (check one):</b> Original _____ Revised * _____ Canceled _____ Courtesy _____ * Must include copy of notification which is being revised					
<b>II. FACILITY INFORMATION</b> (identify owner, removal contractor, demolition contractor, inspector, and project designer)					
Owner: _____					
Address: _____					
City: _____		State: _____		Zip: _____	
Contact: _____		Telephone #: _____			
Removal Contractor: _____  Address: _____  City: _____ State: _____ Zip: _____  Contact: _____ Phone: _____  IN License #: _____ Expiration: _____			Demolition Contractor: _____  Address: _____  City: _____ State: _____ Zip: _____  Contact: _____ Phone: _____		
Inspector: _____  Address: _____  City: _____ State: _____ Zip: _____  IN License #: _____ Expiration: _____  Phone: _____			(Required for asbestos projects at schools K – 12)  Project Designer: _____  Address: _____  City: _____ State: _____ Zip: _____  IN License #: _____ Expiration: _____  Phone: _____		
<b>III. TYPE OF OPERATION (check one)</b> Renovation: _____ Emergency Renovation: _____ Intentional Burning: _____ Demolition: _____ Ordered Demolition: _____					
<b>IV. IS ASBESTOS PRESENT? (check one)</b> YES: _____ NO: _____					
<b>V. PROCEDURES, INCLUDING ANALYTICAL METHODS, IF APPROPRIATE. USED TO DETECT THE PRESENCE AND AMOUNT OF ASBESTOS MATERIAL</b> _____					
<b>VI. APPROXIMATE AMOUNT OF ASBESTOS</b> (Including Regulated ACM, Category I non-friable Category II non-friable ACM)					
	Regulated ACM to be removed	Non-friable Asbestos Material To be removed		Non-friable Asbestos Material Not to be removed before demolition	
		Category I	Category II	Category I	Category II
Pipes (LnFt)					
Surface Area (SqFt)					
Total Volume (CuFt) on/off Components					
<b>VII. SCHEDULED DATES OF ASBESTOS STRIPPING/REMOVAL:</b> Start: _____ End: _____					
<b>VIII. SCHEDULED DATES OF RENOVATION:</b> Start: _____ End: _____      DEMOLITION:      Start: _____ End: _____					
<b>IX. FACILITY DESCRIPTION</b> (Including building name, floor, and room number)					
Building Name: _____					
Street Address: _____					
City: _____		State: _____		County: _____	
Location of removal within building: _____					
Building Size (SqFt): _____			# of Floors: _____		Age: _____
Present Use: _____			Prior use: _____		

X. DESCRIPTION OF PLANNED DEMOLITION OR RENOVATION WORK, METHODS/TECHNIQUES TO BE USED, AFFECTED FACILITY COMPONENTS AND TYPE OF MATERIALS REMOVED

---

---

---

---

XI. DESCRIPTION OF WORK PRACTICES AND ENGINEERING CONTROLS TO BE USED TO PREVENT EMISSIONS OF ASBESTOS AT THE SITE; INCLUDING ASBESTOS STRIPPING, REMOVAL AND WASTE HANDLING PROCEDURES TO PREVENT NON-FRIABLE ASBESTOS MATERIAL FROM BECOMING FRIABLE IN THE COURSE OF THE PROJECT:

---

---

---

XII. DESCRIPTION OF PROCEDURES TO BE FOLLOWED IN THE EVENT THAT UNEXPECTED ASBESTOS IS FOUND OR PREVIOUSLY NON-FRIABLE ASBESTOS MATERIAL BECOMES CRUMBLLED, PULVERIZED, OR REDUCED POWDER:

---

---

---

XIII. WASTE TRANSPORTER

Name: \_\_\_\_\_  
Address: \_\_\_\_\_  
City: \_\_\_\_\_ State: \_\_\_\_\_ Zip: \_\_\_\_\_  
Contact: \_\_\_\_\_ Phone: \_\_\_\_\_

XIV. WASTE DISPOSAL SITE

Name: \_\_\_\_\_  
Address: \_\_\_\_\_  
City: \_\_\_\_\_ State: \_\_\_\_\_ Zip: \_\_\_\_\_  
Contact: \_\_\_\_\_ Phone: \_\_\_\_\_

XV. IF DEMOLITION ORDERED BY A GOVERNMENT AGENCY, IDENTIFY THE AGENCY BELOW AND ATTACH A COPY OF THE ORDER TO THIS FORM. IF THE FACILITY IS NOT INSPECTED PRIOR TO DEMOLITION, THE DEBRIS MUST BE KEPT ADEQUATELY WET. THE DEBRIS MUST THEN BE INSPECTED AFTER DEMOLITION OR ASSUME ALL DEBRIS TO BE CONTAMINATED WITH RACM AND DISPOSED OF APPROPRIATELY TO COMPLY WITH 326 IAC 14-10-1(b).

Name: \_\_\_\_\_ Title: \_\_\_\_\_ Date ordered to begin: \_\_\_\_\_  
Authority: \_\_\_\_\_ Date of Order: \_\_\_\_\_

XVI. FOR EMERGENCY RENOVATIONS:

Date and time of emergency: \_\_\_\_\_

Description of sudden, unexpected event: \_\_\_\_\_

Explanation of how the event caused unsafe conditions or would cause equipment damage: \_\_\_\_\_

XVII. I HEREBY CERTIFY THAT THE INFORMATION IN THIS NOTIFICATION IS CORRECT AND THAT I WILL ONLY USE INDIANA LICENSED WORKERS AND PROJECT SUPERVISORS, TO IMPLEMENT THIS ASBESTOS PROJECT, WHICH HAVE BEEN TRAINED IN 326IAC 14-10; 40 CFR PART 61, SUBPART M; AND, IF APPLICABLE, INDIANAPOLIS AIR POLLUTION CONTROL BOARD REGULATION 14. THE TRAINED INDIVIDUAL(S) ALONG WITH EVIDENCE THAT THE REQUIRED TRAINING WAS ACCOMPLISHED SHALL BE AVAILABLE AT THE JOB SITE DURING ACTUAL WORKING HOURS.

Owner/operator (signature)

date

Owner/operator (printed)

affiliation

\*\*\*\*\* OFFICE USE ONLY \*\*\*\*\*

POSTMARK:

RECEIVED:

REVIEWED BY:

DEFICIENCIES:

Report for:

**Ellen Mullen**  
**Crane Environmental Services, LLC**  
4209 Highway 41 North, Suite 24  
Evansville, IN 47711

---

Regarding: Project: 119-0051; 701 N. 10th Street  
EML ID: 2151503

Approved by:



Approved Signatory  
Tracy Garcia

Dates of Analysis:  
Asbestos PLM: 05-06-2019

Service SOPs: Asbestos PLM (EPA 40CFR App E to Sub E of Part 763 & EPA METHOD 600/R-93-116, SOP EM-AS-S-1267)

---

All samples were received in acceptable condition unless noted in the Report Comments portion in the body of the report. The results relate only to the samples as received. The results include an inherent uncertainty of measurement associated with estimating percentages by polarized light microscopy. Measurement uncertainty data for sample results with >1% asbestos concentration can be provided when requested.

EMLab P&K ("the Company") shall have no liability to the client or the client's customer with respect to decisions or recommendations made, actions taken or courses of conduct implemented by either the client or the client's customer as a result of or based upon the Test Results. In no event shall the Company be liable to the client with respect to the Test Results except for the Company's own willful misconduct or gross negligence nor shall the Company be liable for incidental or consequential damages or lost profits or revenues to the fullest extent such liability may be disclaimed by law, even if the Company has been advised of the possibility of such damages, lost profits or lost revenues. In no event shall the Company's liability with respect to the Test Results exceed the amount paid to the Company by the client therefor.

Client: Crane Environmental Services, LLC  
 C/O: Ellen Mullen  
 Re: 119-0051; 701 N. 10th Street

Date of Sampling: 04-30-2019  
 Date of Receipt: 05-01-2019  
 Date of Report: 05-06-2019

**ASBESTOS PLM REPORT****Total Samples Submitted:** 22**Total Samples Analyzed:** 22**Total Samples with Layer Asbestos Content > 1%:** 1**Location: 1-1, Hard Plaster Wall**

Lab ID-Version‡: 10203072-1

Sample Layers	Asbestos Content
Multicolored Paint	ND
Brown Tape	ND
White Skim Coat	ND
Brown Plaster	ND
<b>Composite Non-Asbestos Content:</b>	10% Cellulose
<b>Sample Composite Homogeneity:</b>	Good

**Location: 1-2, Hard Plaster Wall**

Lab ID-Version‡: 10203073-1

Sample Layers	Asbestos Content
Pink Paint	ND
Brown Tape	ND
White Skim Coat	ND
Brown Plaster	ND
<b>Composite Non-Asbestos Content:</b>	10% Cellulose
<b>Sample Composite Homogeneity:</b>	Good

**Location: 1-3, Hard Plaster Wall**

Lab ID-Version‡: 10203074-1

Sample Layers	Asbestos Content
Black Paint	ND
Brown Tape	ND
White Skim Coat	ND
Brown Plaster	ND
<b>Composite Non-Asbestos Content:</b>	10% Cellulose
<b>Sample Composite Homogeneity:</b>	Good

The test report shall not be reproduced except in full, without written approval of the laboratory. The report must not be used by the client to claim product certification, approval, or endorsement by any agency of the federal government. EMLab P&K reserves the right to dispose of all samples after a period of thirty (30) days, according to all state and federal guidelines, unless otherwise specified.

Inhomogeneous samples are separated into homogeneous subsamples and analyzed individually. ND means no fibers were detected. When detected, the minimum detection and reporting limit is less than 1% unless point counting is performed. Floor tile samples may contain large amounts of interference material and it is recommended that the sample be analyzed by gravimetric point count analysis to lower the detection limit and to aid in asbestos identification.

‡ A "Version" indicated by "-x" after the Lab ID# with a value greater than 1 indicates a sample with amended data. The revision number is reflected by the value of "x".

Client: Crane Environmental Services, LLC  
C/O: Ellen Mullen  
Re: 119-0051; 701 N. 10th Street

Date of Sampling: 04-30-2019  
Date of Receipt: 05-01-2019  
Date of Report: 05-06-2019

**ASBESTOS PLM REPORT****Location: 1-4, Hard Plaster Ceiling**

Lab ID-Version‡: 10203075-1

Sample Layers	Asbestos Content
Off-White Skim Coat with Paint	ND
Brown Plaster	ND
<b>Composite Non-Asbestos Content:</b>	< 1% Cellulose
<b>Sample Composite Homogeneity:</b>	Good

The test report shall not be reproduced except in full, without written approval of the laboratory. The report must not be used by the client to claim product certification, approval, or endorsement by any agency of the federal government. EMLab P&K reserves the right to dispose of all samples after a period of thirty (30) days, according to all state and federal guidelines, unless otherwise specified.

Inhomogeneous samples are separated into homogeneous subsamples and analyzed individually. ND means no fibers were detected. When detected, the minimum detection and reporting limit is less than 1% unless point counting is performed. Floor tile samples may contain large amounts of interference material and it is recommended that the sample be analyzed by gravimetric point count analysis to lower the detection limit and to aid in asbestos identification.

‡ A "Version" indicated by -"x" after the Lab ID# with a value greater than 1 indicates a sample with amended data. The revision number is reflected by the value of "x".

Client: Crane Environmental Services, LLC  
 C/O: Ellen Mullen  
 Re: 119-0051; 701 N. 10th Street

Date of Sampling: 04-30-2019  
 Date of Receipt: 05-01-2019  
 Date of Report: 05-06-2019

**ASBESTOS PLM REPORT****Location: 1-5, Hard Plaster Ceiling**

Lab ID-Version‡: 10203076-1

Sample Layers	Asbestos Content
Pink Paint	ND
Brown Tape	ND
White Skim Coat	ND
Brown Plaster	ND
<b>Composite Non-Asbestos Content:</b>	10% Cellulose
<b>Sample Composite Homogeneity:</b>	Good

**Location: 1-6, Hard Plaster Ceiling**

Lab ID-Version‡: 10203077-1

Sample Layers	Asbestos Content
Off-White Skim Coat with Paint	ND
Brown Plaster	ND
<b>Composite Non-Asbestos Content:</b>	< 1% Cellulose
<b>Sample Composite Homogeneity:</b>	Good

**Location: 1-7, Ceiling Tile**

Lab ID-Version‡: 10203078-1

Sample Layers	Asbestos Content
Gray Ceiling Tile with White Surface	ND
<b>Composite Non-Asbestos Content:</b>	30% Cellulose 3% Mineral Wool
<b>Sample Composite Homogeneity:</b>	Good

**Location: EX-1, Asphalt Siding**

Lab ID-Version‡: 10203079-1

Sample Layers	Asbestos Content
Black Roofing Shingle with Multicolored Pebbles	ND
<b>Composite Non-Asbestos Content:</b>	20% Cellulose
<b>Sample Composite Homogeneity:</b>	Good

The test report shall not be reproduced except in full, without written approval of the laboratory. The report must not be used by the client to claim product certification, approval, or endorsement by any agency of the federal government. EMLab P&K reserves the right to dispose of all samples after a period of thirty (30) days, according to all state and federal guidelines, unless otherwise specified.

Inhomogeneous samples are separated into homogeneous subsamples and analyzed individually. ND means no fibers were detected. When detected, the minimum detection and reporting limit is less than 1% unless point counting is performed. Floor tile samples may contain large amounts of interference material and it is recommended that the sample be analyzed by gravimetric point count analysis to lower the detection limit and to aid in asbestos identification.

‡ A "Version" indicated by "-x" after the Lab ID# with a value greater than 1 indicates a sample with amended data. The revision number is reflected by the value of "x".

Client: Crane Environmental Services, LLC  
 C/O: Ellen Mullen  
 Re: 119-0051; 701 N. 10th Street

Date of Sampling: 04-30-2019  
 Date of Receipt: 05-01-2019  
 Date of Report: 05-06-2019

**ASBESTOS PLM REPORT****Location: EX-2, Asphalt Siding**

Lab ID-Version‡: 10203080-1

Sample Layers	Asbestos Content
Black Roofing Shingle with Red Pebbles	ND
Brown Fibrous Material	ND
<b>Composite Non-Asbestos Content:</b>	60% Cellulose
<b>Sample Composite Homogeneity:</b>	Good

**Location: 1-8, Duct Tape**

Lab ID-Version‡: 10203082-1

Sample Layers	Asbestos Content
Gray Tape	ND
<b>Sample Composite Homogeneity:</b>	Good

**Location: 1-9, Ceiling Tile**

Lab ID-Version‡: 10203083-1

Sample Layers	Asbestos Content
Gray Ceiling Tile with White Surface	ND
<b>Composite Non-Asbestos Content:</b>	30% Cellulose 3% Mineral Wool
<b>Sample Composite Homogeneity:</b>	Good

**Location: B-1, Duct Wrap**

Lab ID-Version‡: 10203084-1

Sample Layers	Asbestos Content
Brown Wrap	70% Chrysotile
<b>Sample Composite Homogeneity:</b>	Good

The test report shall not be reproduced except in full, without written approval of the laboratory. The report must not be used by the client to claim product certification, approval, or endorsement by any agency of the federal government. EMLab P&K reserves the right to dispose of all samples after a period of thirty (30) days, according to all state and federal guidelines, unless otherwise specified.

Inhomogeneous samples are separated into homogeneous subsamples and analyzed individually. ND means no fibers were detected. When detected, the minimum detection and reporting limit is less than 1% unless point counting is performed. Floor tile samples may contain large amounts of interference material and it is recommended that the sample be analyzed by gravimetric point count analysis to lower the detection limit and to aid in asbestos identification.

‡ A "Version" indicated by "-x" after the Lab ID# with a value greater than 1 indicates a sample with amended data. The revision number is reflected by the value of "x".

Client: Crane Environmental Services, LLC  
 C/O: Ellen Mullen  
 Re: 119-0051; 701 N. 10th Street

Date of Sampling: 04-30-2019  
 Date of Receipt: 05-01-2019  
 Date of Report: 05-06-2019

**ASBESTOS PLM REPORT****Location: B-2, Duct Tape**

Lab ID-Version‡: 10203085-1

Sample Layers	Asbestos Content
Gray Tape	ND
<b>Sample Composite Homogeneity:</b> Good	

**Location: 2-1, Hard Plaster Wall**

Lab ID-Version‡: 10203086-1

Sample Layers	Asbestos Content
White Skim Coat with Gray Paint	ND
Brown Plaster	ND
<b>Sample Composite Homogeneity:</b> Good	

**Location: 2-2, Hard Plaster Wall**

Lab ID-Version‡: 10203087-1

Sample Layers	Asbestos Content
Brown Plaster	ND
<b>Sample Composite Homogeneity:</b> Good	

**Location: 2-3, Hard Plaster Wall**

Lab ID-Version‡: 10203088-1

Sample Layers	Asbestos Content
White Skim Coat with Gray Paint	ND
Brown Plaster	ND
<b>Sample Composite Homogeneity:</b> Good	

The test report shall not be reproduced except in full, without written approval of the laboratory. The report must not be used by the client to claim product certification, approval, or endorsement by any agency of the federal government. EMLab P&K reserves the right to dispose of all samples after a period of thirty (30) days, according to all state and federal guidelines, unless otherwise specified.

Inhomogeneous samples are separated into homogeneous subsamples and analyzed individually. ND means no fibers were detected. When detected, the minimum detection and reporting limit is less than 1% unless point counting is performed. Floor tile samples may contain large amounts of interference material and it is recommended that the sample be analyzed by gravimetric point count analysis to lower the detection limit and to aid in asbestos identification.

‡ A "Version" indicated by "-x" after the Lab ID# with a value greater than 1 indicates a sample with amended data. The revision number is reflected by the value of "x".



Client: Crane Environmental Services, LLC  
 C/O: Ellen Mullen  
 Re: 119-0051; 701 N. 10th Street

Date of Sampling: 04-30-2019  
 Date of Receipt: 05-01-2019  
 Date of Report: 05-06-2019

**ASBESTOS PLM REPORT****Location: 2-4, Hard Plaster Ceiling**

Lab ID-Version‡: 10203089-1

Sample Layers	Asbestos Content
Gray Paint	ND
Brown Tape	ND
White Skim Coat	ND
Brown Plaster	ND
<b>Composite Non-Asbestos Content:</b>	10% Cellulose
<b>Sample Composite Homogeneity:</b>	Poor

**Location: 2-5, Hard Plaster Ceiling**

Lab ID-Version‡: 10203090-1

Sample Layers	Asbestos Content
Multicolored Plaster	ND
Brown Debris	ND
<b>Composite Non-Asbestos Content:</b>	5% Cellulose
<b>Sample Composite Homogeneity:</b>	Poor

**Location: 2-6, Hard Plaster Ceiling**

Lab ID-Version‡: 10203091-1

Sample Layers	Asbestos Content
Gray Paint	ND
Brown Tape	ND
White Skim Coat	ND
Brown Plaster	ND
<b>Composite Non-Asbestos Content:</b>	10% Cellulose
<b>Sample Composite Homogeneity:</b>	Poor

**Location: 2-7, Ceiling Tile**

Lab ID-Version‡: 10203092-1

Sample Layers	Asbestos Content
Brown Ceiling Tile with White Surface	ND
<b>Composite Non-Asbestos Content:</b>	85% Cellulose
<b>Sample Composite Homogeneity:</b>	Good

The test report shall not be reproduced except in full, without written approval of the laboratory. The report must not be used by the client to claim product certification, approval, or endorsement by any agency of the federal government. EMLab P&K reserves the right to dispose of all samples after a period of thirty (30) days, according to all state and federal guidelines, unless otherwise specified.

Inhomogeneous samples are separated into homogeneous subsamples and analyzed individually. ND means no fibers were detected. When detected, the minimum detection and reporting limit is less than 1% unless point counting is performed. Floor tile samples may contain large amounts of interference material and it is recommended that the sample be analyzed by gravimetric point count analysis to lower the detection limit and to aid in asbestos identification.

‡ A "Version" indicated by "-x" after the Lab ID# with a value greater than 1 indicates a sample with amended data. The revision number is reflected by the value of "x".

Client: Crane Environmental Services, LLC  
 C/O: Ellen Mullen  
 Re: 119-0051; 701 N. 10th Street

Date of Sampling: 04-30-2019  
 Date of Receipt: 05-01-2019  
 Date of Report: 05-06-2019

**ASBESTOS PLM REPORT****Location: Dup-1, Hard Plaster Wall**

Lab ID-Version‡: 10203093-1

Sample Layers	Asbestos Content
Light Gray Paint	ND
Brown Paint	ND
Orange Paint	ND
Brown Tape	ND
Brown/White Plaster	ND
<b>Composite Non-Asbestos Content:</b>	15% Cellulose
<b>Sample Composite Homogeneity:</b>	Good

**Location: Dup-2, Hard Plaster Ceiling**

Lab ID-Version‡: 10203094-1

Sample Layers	Asbestos Content
Gray Paint	ND
Brown Tape	ND
White Skim Coat	ND
Brown Plaster	ND
<b>Composite Non-Asbestos Content:</b>	10% Cellulose
<b>Sample Composite Homogeneity:</b>	Poor

The test report shall not be reproduced except in full, without written approval of the laboratory. The report must not be used by the client to claim product certification, approval, or endorsement by any agency of the federal government. EMLab P&K reserves the right to dispose of all samples after a period of thirty (30) days, according to all state and federal guidelines, unless otherwise specified.

Inhomogeneous samples are separated into homogeneous subsamples and analyzed individually. ND means no fibers were detected. When detected, the minimum detection and reporting limit is less than 1% unless point counting is performed. Floor tile samples may contain large amounts of interference material and it is recommended that the sample be analyzed by gravimetric point count analysis to lower the detection limit and to aid in asbestos identification.

‡ A "Version" indicated by "-x" after the Lab ID# with a value greater than 1 indicates a sample with amended data. The revision number is reflected by the value of "x".

**www.EMLabPK.com**



## EMLab P&K

Cherry Hill, NJ: 1936 Olney Avenue, Cherry Hill, NJ 08003 \* (856) 571-1984  
Phoenix, AZ: 1501 West Knudsen Drive, Phoenix, AZ 85027 \* (800) 651-4802  
San Bruno, CA: 1150 Bayhill Drive, #100, San Bruno, CA 94066 \* (856) 888-6653

WEATHER		Fog	Rain	Snow	Wind	Clear
LEVEL	None					
	Light					
	Moderate					
	Heavy					

**REQUEST**

002151503

CONTACT INFORMATION					
Company: Crane Environmental Services, LLC			Address: 1120 Star Gate Court, Evansville, IN 47725		
Contact: Ellen R. Mullen			Special Instructions:		
Phone: (812) 868-0709			Account #: 4001		
PROJECT INFORMATION			TURN AROUND TIME CODES - (TAT)		
Project ID: 119-0051			STD - Standard (DEFAULT)		Rushes received after 2pm or on weekends, will be considered received the next business day. Please alert us in advance of weekend analysis needs.
Project Desc.: 701 N. 10th Street			ND - Next Business Day		
Project Zip Code: 47712			SD - Same Business Day Rush		
Sampling Date & Time: 4/30/19 2:00 p.m.			WH - Weekend/Holiday		
PO Number:					
SAMPLE ID	DESCRIPTION	Sample Type (Below)	TAT (Above)	Total Volume/Area (as applicable)	NOTES (Time of day, Temp, RH, etc.)
1-1	Hard Plaster Wall	B	STD		
1-2	Hard Plaster Wall	B	STD		
1-3	Hard Plaster Wall	B	STD		
1-4	Hard Plaster Ceiling	B	STD		
1-5	Hard Plaster Ceiling	B	STD		
1-6	Hard Plaster Ceiling	B	STD		
1-7	Ceiling Tile	B	STD		
EX-1	Asphalt Siding	B	STD		
EX-2	Asphalt Siding	B	STD		
1-7	Ceiling Tile	B	STD		
1-8	Duct Tape	B	STD		
1-9	Ceiling Tile	B	STD		
SAMPLE TYPE CODES				RELINQUISHED BY	DATE & TIME
BC - BioCassette™	CP - Contact Plate	T - Tape	D - Dust	Jared Ba	4/30/19 5:00 P.M.
ATS - Andersen	ST - Spore Trap: Zefon, Allergenco, Burkard...	SW - Swab	W - Water		
SAS - Surface Air Sampler		B - Bulk	SO - Soil		
				RECEIVED BY	DATE & TIME
				J. Garcia	5/1/19 9:02

By submitting this Chain of Custody, you agree to be bound by the terms and conditions set forth at [www.emlabpk.com/terms.html](http://www.emlabpk.com/terms.html)

Copyright © 2002-2008 EMLab P&K

## CHAIN OF CUSTODY

www.EMLabPK.com



Cherry Hill, NJ: 1936 Olney Avenue, Cherry Hill, NJ 08003 \* (866) 871-1984  
 Phoenix, AZ: 1501 West Knudsen Drive, Phoenix, AZ 85027 \* (800) 651-4802  
 San Bruno, CA: 1150 Bayhill Drive, #100, San Bruno, CA 94066 \* (866) 888-6653

WEATHER	Fog	Rain	Snow	Wind	Clear
LEVEL	None				
	Light				
	Moderate				
	Heavy				

REQUEST

002151503

CONTACT INFORMATION	
Company: Crane Environmental Services, LLC	Address: 1120 Star Gate Court, Evansville, IN 47725
Contact: Ellen R. Mullen	Special Instructions:
Phone: (812) 868-0709	Account #: 4001

PROJECT INFORMATION		TURN AROUND TIME CODES - (TAT)	
Project ID: 119-0051		STD - Standard (DEFAULT)	Rushes received after 2pm or on weekends, will be considered received the next business day. Please alert us in advance of weekend analysis needs.
Project Desc: 701 N. 10th Street		ND - Next Business Day	
Project Zip Code: 47712	Sampling Date & Time: 4/30/19 2:00 p.m.	SD - Same Business Day Rush	
PO Number:		WH - Weekend/Holiday	

SAMPLE ID	DESCRIPTION	Sample Type (Below)	TAT (Above)	Total Volume/Area (as applicable)	NOTES (Time of day, Temp, RH, etc.)
B-1	Duct Wrap	B	STD		
B-2	Duct Tape	B	STD		
2-1	Hard Plaster Wall	B	STD		
2-2	Hard Plaster Wall	B	STD		
2-3	Hard Plaster Wall	B	STD		
2-4	Hard Plaster Ceiling	B	STD		
2-5	Hard Plaster Ceiling	B	STD		
2-6	Hard Plaster Ceiling	B	STD		
2-7	Ceiling Tile	B	STD		
Dup-1	Hard Plaster Wall	B	STD		
Dup-2	Hard Plaster Ceiling	B	STD		

SAMPLE TYPE CODES			
BC - BioCassette™	CP - Contact Plate	T - Tape	D - Dust
ATS - Andersen	ST - Spore Trap: Zefon, Allergenco, Burkard...	SW - Swab	W - Water
SAS - Surface Air Sampler		B - Bulk	SO - Soil
O - Other:			

RELINQUISHED BY	DATE & TIME
<i>John B...</i>	4/30/19 5:00 P.M.

Non-Culturable		BioCassette™ Andersen, SAS, Swab, Water, Bulk, Dust, Soil, Contact Plate	
Spore Trap	Tape Swab Bulk		
Fungi - Spore Trap Analysis	Spore Trap Analysis - Other particles		
Direct Microscopic Exam (Qualitative)	Quantitative Spore Count Direct Exam		
1-Media Surface Fungi (Genus ID + App. spp.)	2-Media Surface Fungi (Genus ID + App. spp.)		
3-Media Surface Fungi (Genus ID + App. spp.)	Culturable Air Fungi (Genus ID + App. spp.)		
Gram Stain and Counts (Culturable Air and Surface Bacteria)	Legionella culture		
Total Coliform, E. coli (Presence/Absence)	Membrane Filtrations (Please specify organism)		
MPN Bacteria (Please specify organism)	Quantal Tray - Sewage Screen		
Asbestos Analysis - PCM Airborne Fiber Count (NIOSH 7400)	Asbestos Analysis - PLM (EPA method 600/9-93-116)		
PCR (please specify test)			

RECEIVED BY	DATE & TIME
<i>J. Lancia</i>	5/1/19 9:02 a.m.

By submitting this Chain of Custody, you agree to be bound by the terms and conditions set forth at [www.emlabpk.com/terms.html](http://www.emlabpk.com/terms.html)

Copyright © 2002-2008 EMLab P&amp;K



**Crane Environmental Services, Inc.**  
4209 Highway 41 North  
Suite 24  
Evansville, IN 47711  
(812) 909-0829 Fax: (812) 909-0471


# CHAIN OF CUSTODY

**Project:** 119-0051  
**Sampled By:** Jarred Bannon

**Location:** 701 North 10th Street  
**Date:** 4/30/2019

[illegible]

<b>KEY</b>	<b>PI</b>	Pipe Insulation	<b>JC</b>	Joint Comp.	<b>FT</b>	Floor Tile	<b>CLK</b>	Caulking
	<b>PJ</b>	Pipe Joint	<b>INS</b>	Insulation	<b>ShVF</b>	Sheet Vinyl	<b>OT</b>	Other (explain)
	<b>HP</b>	Hard Plaster	<b>CT</b>	Ceiling Tile	<b>TR</b>	Transite	<b>UK</b>	Unknown

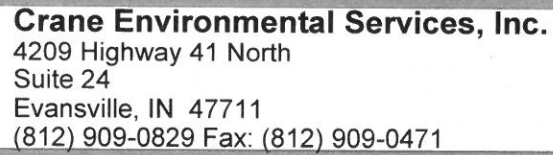

**Location:** 701 North 10th Street  
**Date:** 4/30/2019

<b>KEY</b>	<b>PI</b>	Pipe Insulation	<b>JC</b>	Joint Comp.	<b>FT</b>	Floor Tile	<b>CLK</b>	Caulking
	<b>PJ</b>	Pipe Joint	<b>INS</b>	Insulation	<b>ShVF</b>	Sheet Vinyl	<b>OT</b>	Other (explain)
	<b>HP</b>	Hard Plaster	<b>CT</b>	Ceiling Tile	<b>TR</b>	Transite	<b>UK</b>	Unknown

# CRANE


**Crane Environmental Services, Inc.**  
 4209 Highway 41 North  
 Suite 24  
 Evansville, IN 47711  
 (812) 909-0829 Fax: (812) 909-0471

# SAMPLING DIAGRAM

**Project:** 119-0051  
**Sampled By:** Jarred Bannon

**Location:** 701 North 10th Street  
**Date:** 4/30/2019

First Floor

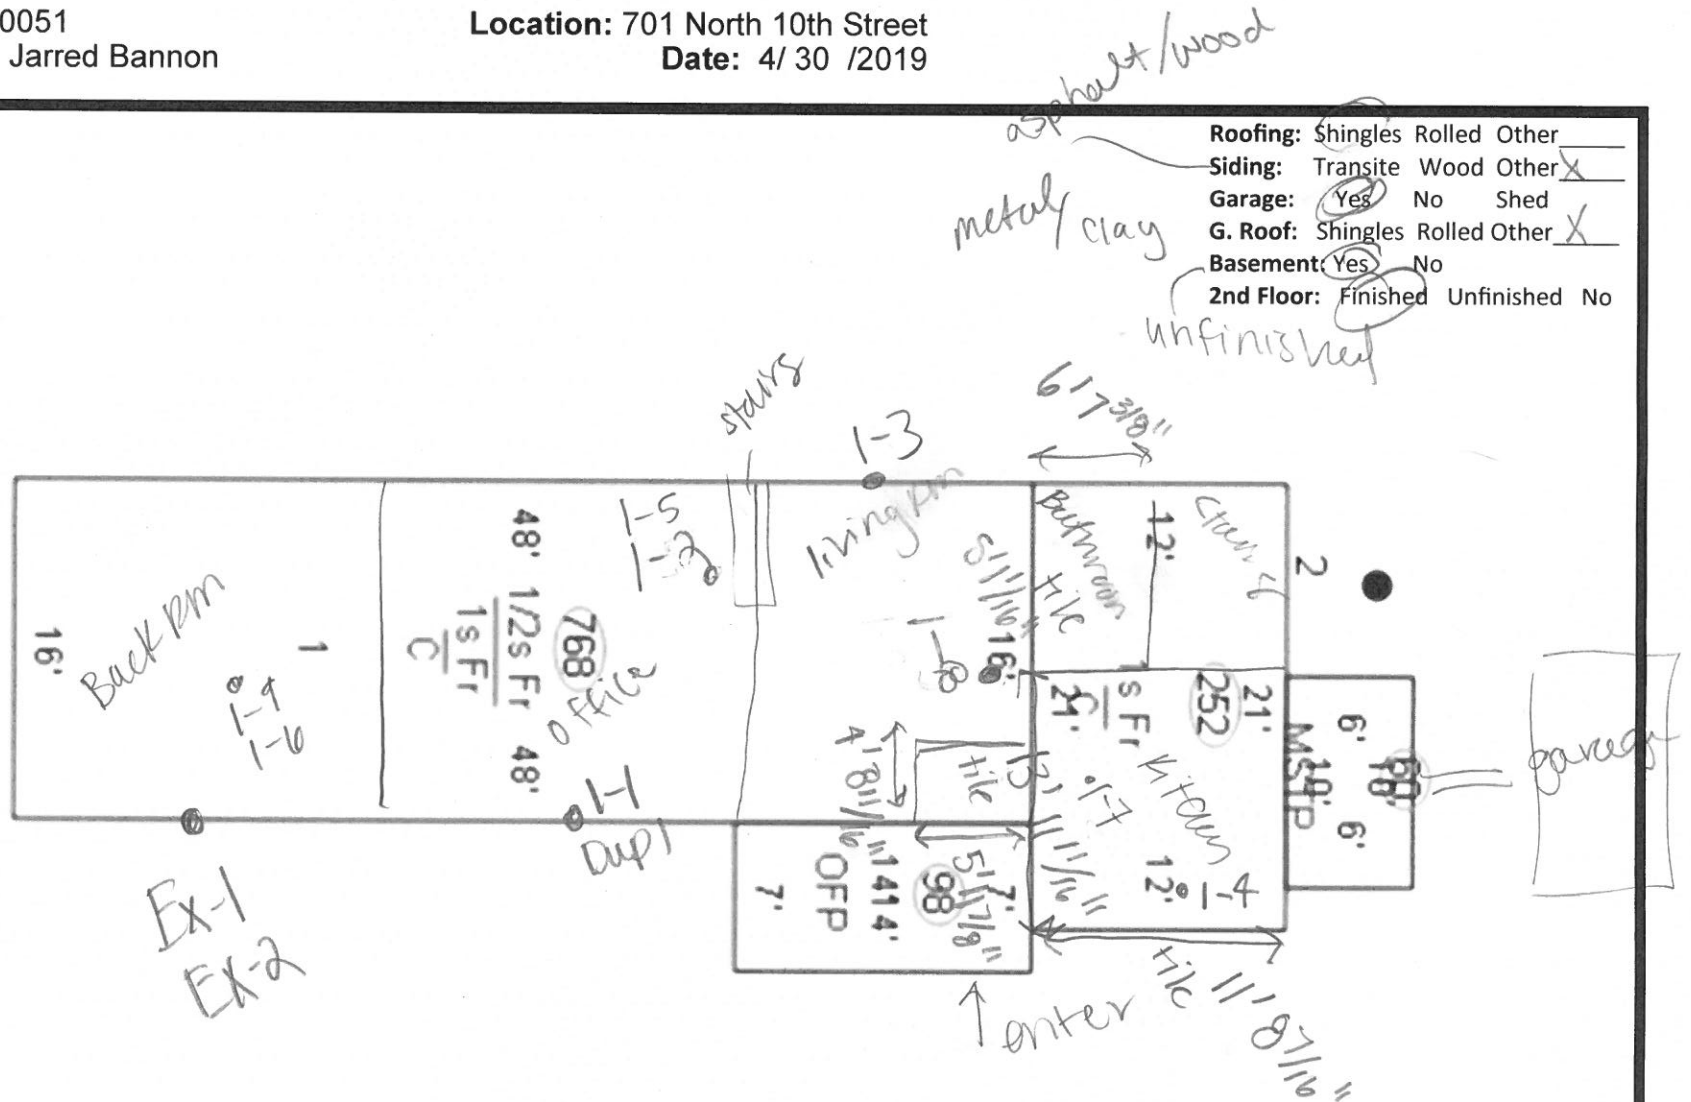

# CRANE

**Crane Environmental Services, Inc.**

4209 Highway 41 North

Suite 24

Evansville, IN 47711

(812) 909-0829 Fax: (812) 909-0471

# SAMPLING DIAGRAM

**Project:** 119-0051

**Sampled By:** Jarred Bannon

**Location:** 701 North 10th Street

**Date:** 4/30/2019

Second Floor

**Roofing:** Shingles Rolled Other \_\_\_\_\_


**Siding:** Transite Wood Other \_\_\_\_\_

**Garage:** Yes No Shed

**G. Roof:** Shingles Rolled Other \_\_\_\_\_

**Basement:** Yes No

**2nd Floor:** Finished Unfinished No

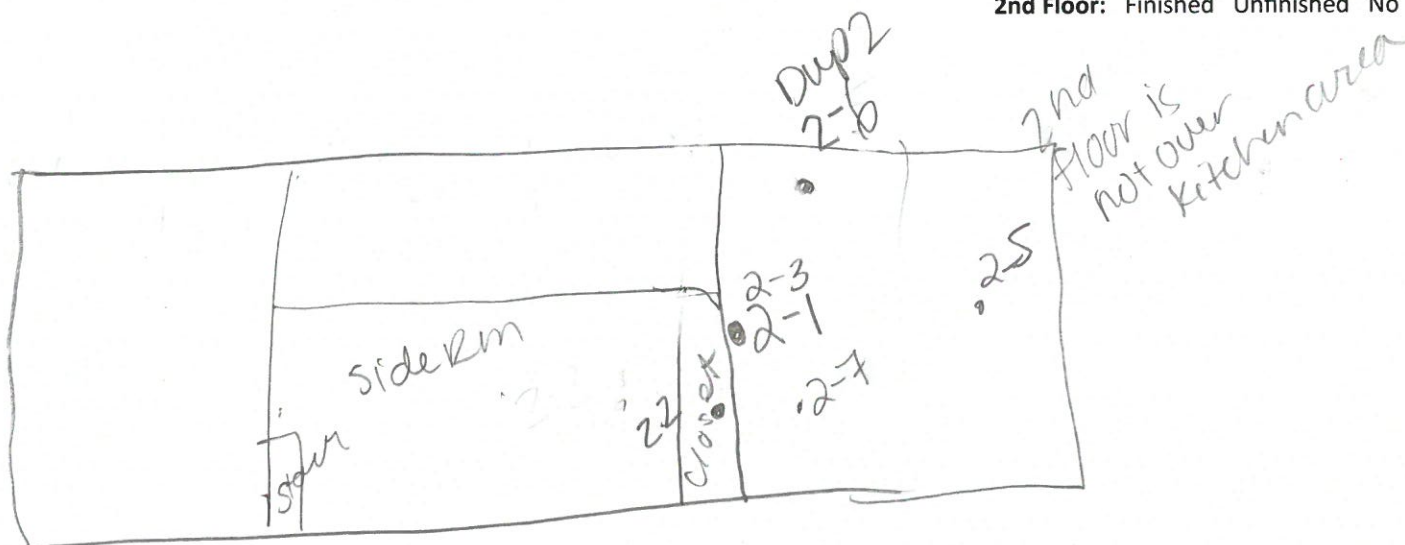

KEY	PI	Pipe Insulation	JC	Joint Comp.	FT	Floor Tile	CLK	Caulking
	PJ	Pipe Joint	INS	Insulation	ShVF	Sheet Vinyl	OT	Other
	HP	Hard Plaster	CT	Ceiling Tile	TR	Transite	UK	Unknown