
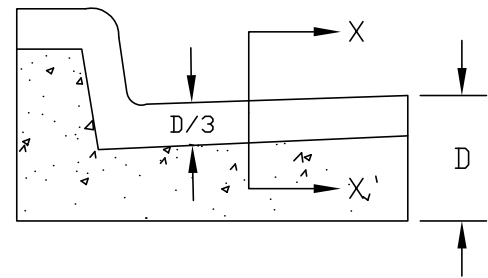


Sawed Contraction Joint

6" CONCRETE CURB

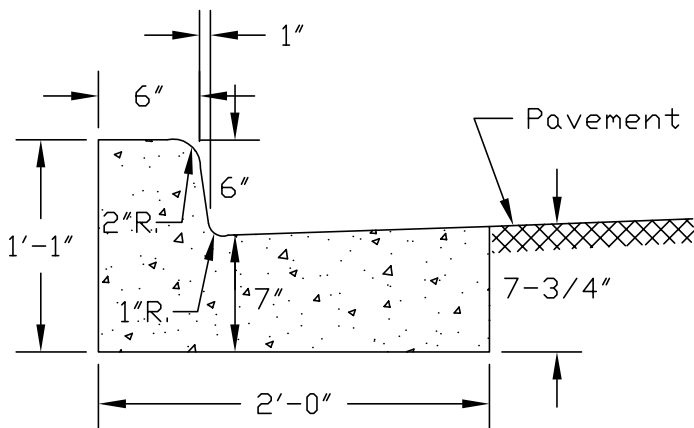


Sawed Contraction Joint

6" COMBINED CURB and GUTTER

NOTES:

- 1.) Formed or sawed contraction joints will be placed on 10' centers (Max.)
- 2.) Where sidewalk and curb are adjacent, sawed contraction joints will be placed in the curb at every other sidewalk joint.
- 3.) All exposed edges shall be rounded with a 1/4" radius tool.
- 4.) Concrete for curb or curb & gutter shall be 3500 psi concrete.

1/8" min., 1/4" max.



Section X-X

CONTRACTION JOINT

- 5.) Subgrade for curb or curb & gutter shall be a minimum of 2" thick of either "B" Borrow or No. 53 crushed stone and mechanically compacted.
- 6.) The cost of the curb or curb & gutter shall include all of the above items.

DETAIL D-1

6" Curb, 6" Combined Curb & Gutter and Contraction Joint
Scale 1"=1' (Rev. Date 10/31/97)