
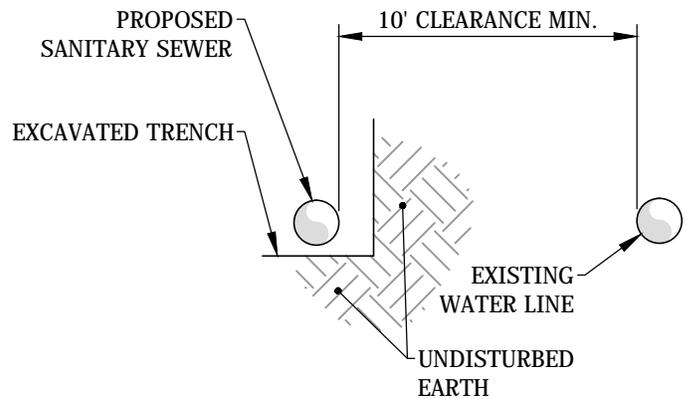


NOTES:

1. CROSSING SHALL BE ARRANGED SO THAT SEWER JOINTS WILL BE EQUIDISTANT AND AS FAR AS POSSIBLE FROM WATER LINE JOINTS.
2. CROSSING MUST BE MADE AT A MINIMUM OF 45 DEGREES MEASURED FROM THE CENTER LINES OF THE MAINS.

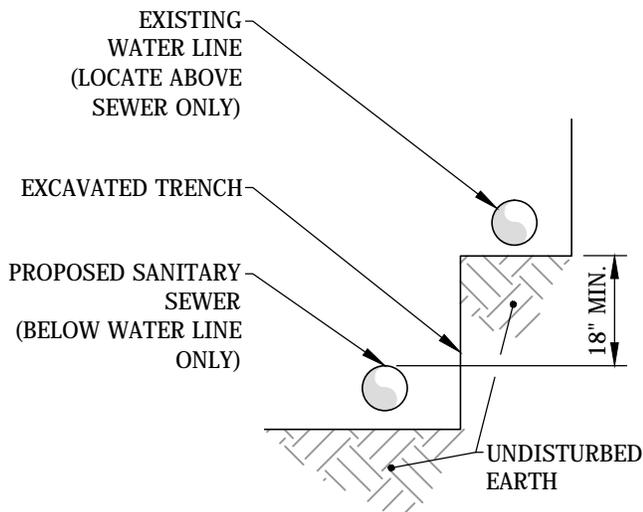

EXCEPTIONS:

ALL OF THE FOLLOWING MUST BE MET

- THE SANITARY SEWER AND WATER MAIN ARE NOT IN CONTACT.
- THE SANITARY SEWER MATERIAL IS PVC SDR-21 OR PVC C900 FOR ALL INSTANCES WHERE HORIZONTAL OR VERTICAL CLEARANCE REQUIREMENTS ARE NOT MET.
- THE SANITARY SEWER MEETS ALL PRESSURE TESTING REQUIREMENTS OF WATER MAIN.
- THE SANITARY SEWER AND WATER MAIN ARE LAID ON SEPARATE TRENCH SHELVES.
- ANY SANITARY SEWER JOINTS ARE A COMPRESSION TYPE JOINT THAT ARE PLACED EQUIDISTANTLY FROM THE WATER MAIN.

File: F:\ENGINEER\AUTOCAD Standards\Detail Drawings Sewer\WW-12 Sanitary Sewer and Water Main Crossing.dwg



PROPOSED SANITARY SEWER AND EXISTING WATER LINE CROSSING

Approved: 11/10/15

Adopted: 11/10/15

Figure

Approved By: Michael D. Labitzke, P.E.

Scale: N.T.S.

WW-12