


PIPING PLAN VIEW

NOTES:

1. NORMAL LATERAL SLOPE IS 1/4" PER FOOT, MINIMUM LATERAL SLOPE IS 1/8" PER FOOT.
2. MINIMUM COVER IS 3 FEET OVER PIPE.
3. ADDITIONAL CLEANOUT REQUIRED AT RIGHT-OF-WAY WHERE LATERAL CROSSES ROADWAY.
4. MINIMUM LATERAL SIZE FROM SEWER MAIN TO PROPERTY LINE CLEANOUT IS 6".
5. WITH SEWER UTILITY APPROVAL, DEEP SEWER SLANT STACK MAY BE INSTALLED; MAY REQUIRE ADDITIONAL EASEMENT.

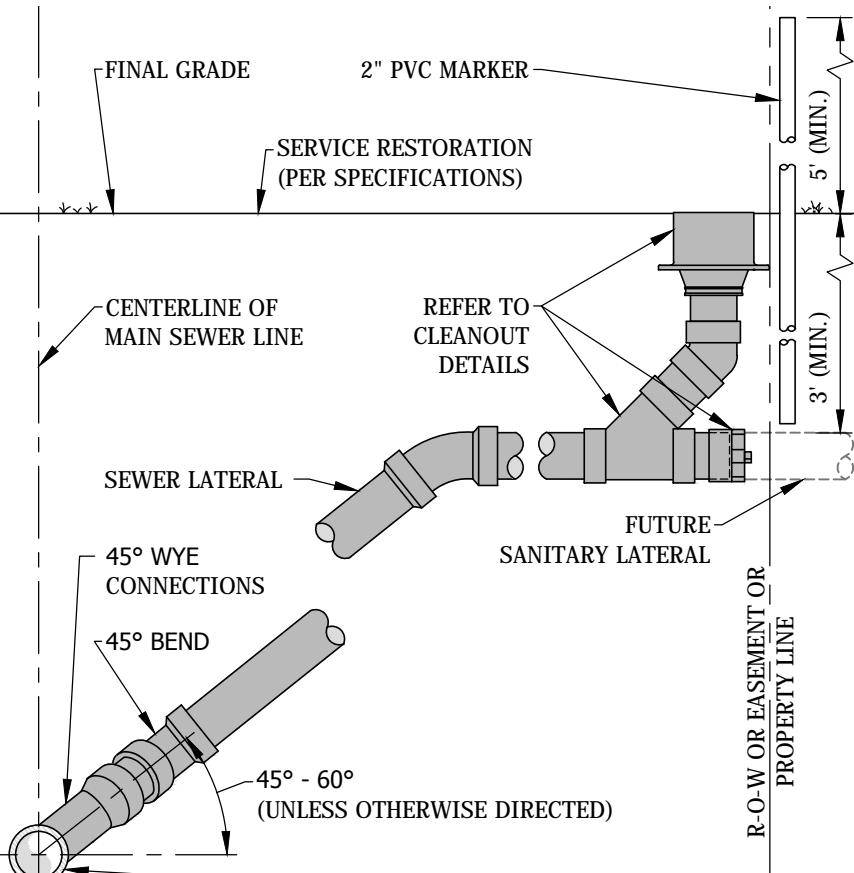

PIPING ELEVATION VIEW

WHEN TRANSITIONING FROM C-900 PVC SEWER MAIN TO SDR-26 PVC LATERAL USE THE "SPECIFIED" BRAND FITTING (OR APPROVED EQUAL) OTHERWISE USE SDR-26 PVC FITTING

CONTRACTOR SHALL PROVIDE "AS-BUILT" SERVICE CONNECTION TIE DOWN MEASUREMENTS TO THE OWNER, ENGINEER, AND PROPERTY OWNER.

Fig. J ENGINEER AUTOCAD Standards Detail Drawings/Sewers/WW 22 Shallow Sanitary Service Connection.dwg



SHALLOW SANITARY SERVICE CONNECTION

Approved: 11/10/15

Adopted: 11/10/15

Figure

Approved By: Michael D. Labitzke, P.E.

Scale: N.T.S.

WW-22