


- NOTES:**
- INTERNAL DROP REQUIRES PERMISSION FROM E.W.S.U. PRIOR TO USE.
 - CONE REPLACEMENT AND / OR REPOSITIONING MAY BE REQUIRED.
 - MINIMUM INSIDE DROP TO BE 36" (INVERT OF THE INCOMING PIPE TO THE INVERT OF THE OUTLET OF THE INTERNAL DROP)

NOTE:
FOR FORCE MAINS, REQUIRED DROP BOWL HOOD BY RELINER / DURAN, INC. OR EQUAL.

File: F:\ENGINEER\AUTOCAD\Standards\Detail Drawings\Sewer\WW-09 Internal Drop Connection to Existing MH.dwg

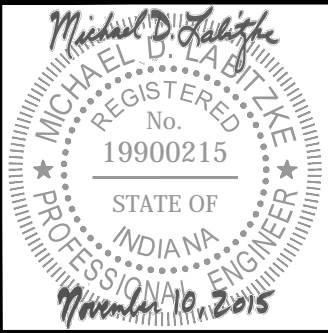

INTERNAL DROP CONNECTION TO EXISTING MANHOLE

Approved: 11/10/15	Adopted: 11/10/15	Figure WW-09
Approved By: Michael D. Labitzke, P.E.	Scale: N.T.S.	