

EXISTING GRADE

SEE SURFACE RESTORATION SPECIFICATIONS AND DETAILS

FINAL BACKFILL

SLOPE TRENCH WALL AT 1:12 SLOPE (TYP.)

PIPE EMBEDMENT

INITIAL BACKFILL COMPACTED #5 OR #8 CRUSHED STONE

HAUNCH TO SPRINGLINE (MANUALLY HAND TAMPED OR WALKED IN #5 OR #8 CRUSHED STONE)

PIPE BEDDING O.D./2 (6" MIN. COMPACTED #5 OR #8 CRUSHED STONE)

SPRINGLINE OF PIPE

TRENCH BOTTOM (OR FOUNDATION) AS REQUIRED


TRENCH MIN. WIDTH = $1.25 \times O.D. + 12"$

BELL IS BELOW THE SURFACE OF THE BEDDING (MIN. OF 5" OF BEDDING BELOW BELL)

NOTES:

1. OSHA TRENCH SAFETY REQUIREMENTS SHALL BE FOLLOWED WITH ALL TRENCH EXCAVATION.
2. INITIAL BACKFILL: #5 OR #8 CRUSHED STONE MANUALLY COMPACTED
3. FINAL BACKFILL: SUITABLE EXCAVATED MATERIAL MAY BE USED, COMPACTED AS SPECIFIED.
4. ALL SUITABLE EXCAVATED MATERIAL SHALL BE FREE OF ROCKS OR MORE THAN TWO INCHES IN DIAMETER, CONCRETE, ROOTS, STUMPS, TRASH, FROZEN MATERIALS, OR OTHER SIMILAR MATERIAL.

File: F:\ENGINEER\AUTOCAD\Standards\Detail Drawings\Sewer\WW-16 Non-Rigid San Sewer Pipe Bedding Beyond 5' of Pavement.dwg

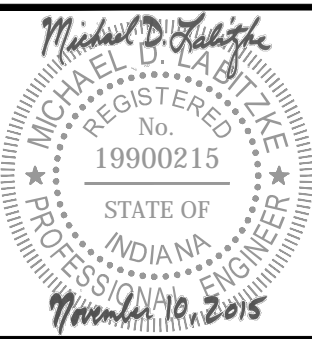

NON-RIGID SANITARY SEWER PIPE BEDDING AND BACKFILL MORE THAN 5' FROM PAVEMENT

Approved: 11/10/15

Adopted: 11/10/15

Figure

Approved By: Michael D. Labitzke, P.E.

Scale: N.T.S.

WW-16