

EXISTING GRADE

SEE SURFACE RESTORATION SPECIFICATIONS AND DETAILS

PAVEMENT (SEE SURFACE RESTORATION SPECIFICATIONS AND DETAILS)

FINAL BACKFILL (PER STREET JURISDICTION REQUIREMENT)

PIPE EMBEDMENT

INITIAL BACKFILL COMPACTED #5 OR #8 CRUSHED STONE

HAUNCH TO SPRINGLINE (MANUALLY HAND TAMPED OR WALKED IN #5 OR #8 CRUSHED STONE)

PIPE BEDDING O.D./2 (6" MIN. COMPACTED #5 OR #8 CRUSHED STONE)

SPRINGLINE OF PIPE

TRENCH BOTTOM (OR FOUNDATION) AS REQUIRED

1  
12

1  
12

1  
12

SLOPE TRENCH WALL AT 1:12 SLOPE (TYP.)

O.D.


12"

TRENCH MIN. WIDTH = 1.25 x O.D. + 12"

BELL IS BELOW THE SURFACE OF THE BEDDING (MIN. OF 5" OF BEDDING BELOW BELL)

NOTE: OSHA TRENCH SAFETY REQUIREMENTS SHALL BE FOLLOWED WITH ALL TRENCH EXCAVATION.

File: F:\ENGINEER\AUTOCAD\Standards\Detail Drawings\Sewer\WW-15 Non-Rigid San Sewer Pipe Bedding within 5' of Pavement.dwg

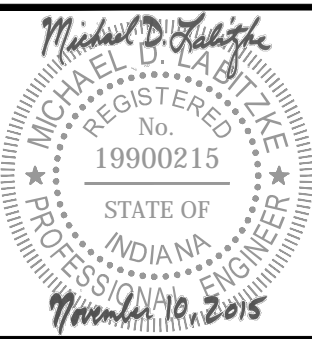

# NON-RIGID SANITARY SEWER PIPE BEDDING AND BACKFILL WITHIN 5' OF, OR UNDER PAVEMENT

Approved: 11/10/15	Adopted: 11/10/15	Figure <b>WW-15</b>
Approved By: Michael D. Labitzke, P.E.	Scale: N.T.S.	