


NOTES:

1. NORMAL LATERAL SLOPE IS 1/4" PER FOOT, MINIMUM LATERAL SLOPE IS 1/8" PER FOOT.
2. MINIMUM COVER IS 3 FEET OVER PIPE.
3. ADDITIONAL CLEANOUT REQUIRED AT RIGHT-OF-WAY WHERE LATERAL CROSSES ROADWAY.
4. . MINIMUM LATERAL SIZE FROM SEWER MAIN TO PROPERTY LINE CLEANOUT IS 6".
5. WITH SEWER UTILITY APPROVAL, DEEP SEWER SLANT STACK MAY BE INSTALLED; MAY REQUIRE ADDITIONAL EASEMENT.

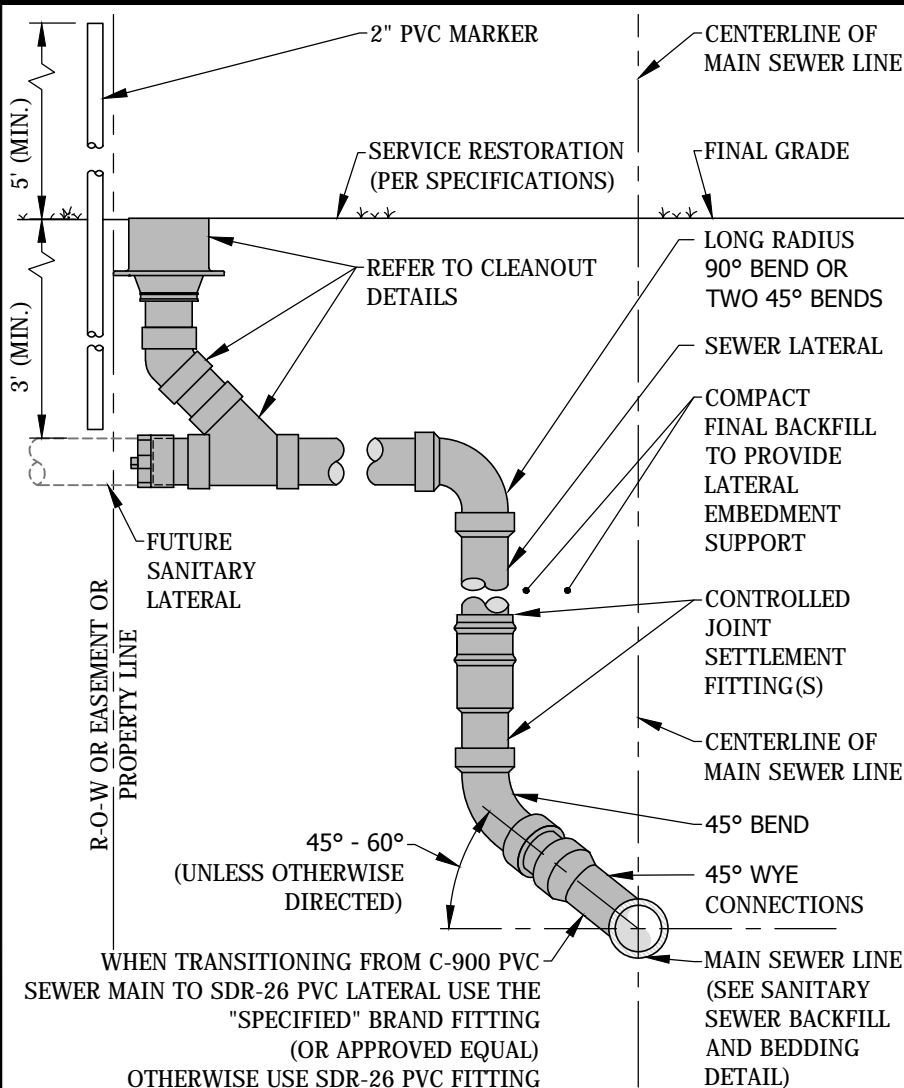

PIPING ELEVATION VIEW

CONTRACTOR SHALL PROVIDE "AS-BUILT" SERVICE CONNECTION TIE DOWN MEASUREMENTS TO THE OWNER, ENGINEER, AND PROPERTY OWNER.

File: J:\ENGINEER\AUTOCAD Standards\Detail Drawings Sewer\WW-23 Deep Sanitary Service Connection.dwg



DEEP SANITARY SERVICE CONNECTION

Approved: 11/10/15

Approved By: Michael D. Labitzke, P.E.

Adopted: 11/10/15

Scale: N.T.S.

Figure

WW-23