

TYLER UNION
VALVE BOX
(TOP SECTION)
WITH COVER
(TO BE MARKED WATER)




VALVE BOX COVER




SERVICE BOX LID

PROVIDE ENOUGH
TRACER WIRE
SO TO PERMIT WIRE
TO BE PULLED TO
36" ABOVE FINAL
GRADE

TYLER UNION
VALVE BOX
(TOP SECTION)
WITH COVER
(TO BE MARKED WATER)

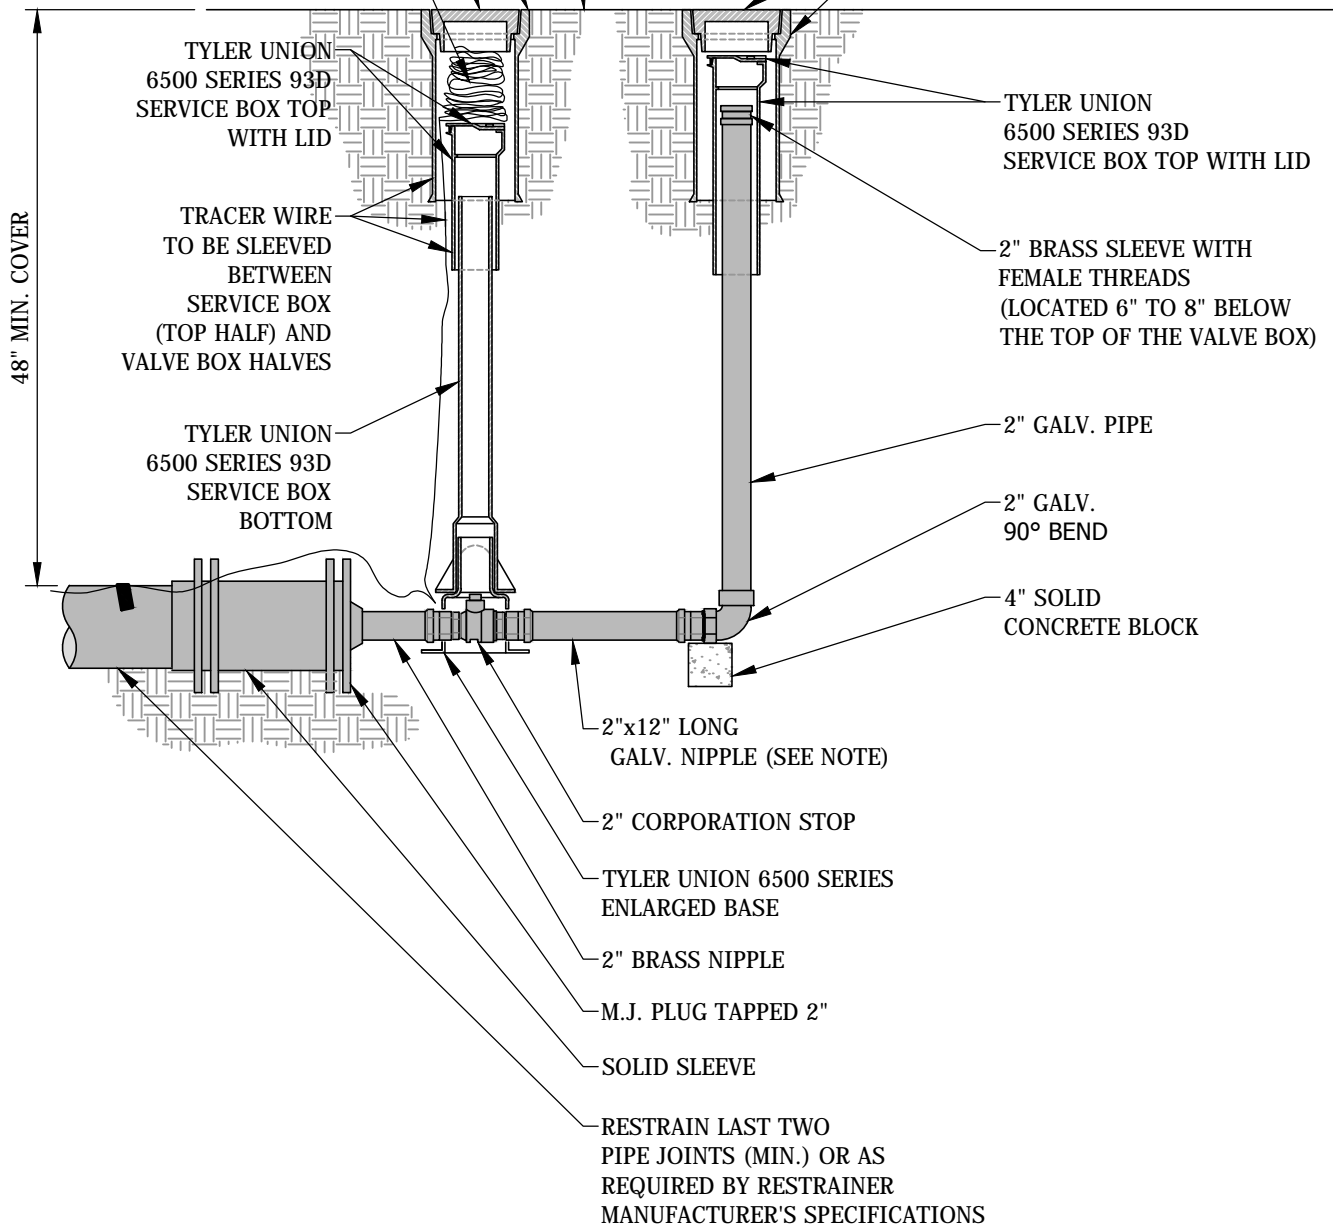

File: J:\ENGINEER\AUTOCAD\Standards\Detail Drawings\Water\DW30-Permanent Blowoff Assembly with 2in Corp Stop.dwg

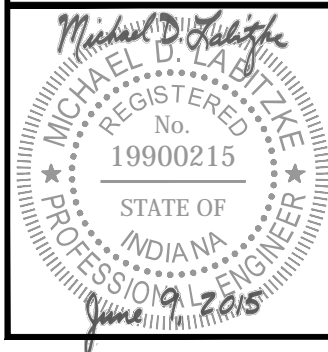

PERMANENT BLOWOFF ASSEMBLY WITH 2" CORPORATION STOP

Approved: 06/09/15

Adopted: 06/09/15

Figure

Approved By: Michael D. Labitzke, P.E.

Scale: N.T.S.

DW30